

| Master - Revit Link Schedule | | | |
|-------------------------------------|-------------------------|----------------|--------------------------|
| RVT Link: File Name | RVT Link: Name | Project Number | Project Name |
| 211056-LETHABA BLDG C_(HVAC)_v22 | HVAC - BUILDING C | 211056 | LETABA COLLEGE |
| 211056-LETHABA BLDG X_(HVAC)_v22 | ARCHITECT - BUILDING BB | 211056 | LETCOL |
| IDW Building C_Rev.B.rvt 2022-08-10 | ARCHITECT - BUILDING C | TS2021_09 | DESIGN OF BUILDING C |
| IDW Building X_Rev.A.rvt 2022-08-10 | ARCHITECT - BUILDING X | TS2021_09 | DESIGN OF BUILDING X |
| LETABA TVET COLLEGE SITE PLAN | ARCHITECT - SITE | TS2021_09 | DESIGN OF BUILDING C & X |

- Legend:**
- Terminal box for cable reticulation in floor
 - Floor box (rectangular) complete with:
 - Power set desktop mounted complete with:
 - Wall box complete with:
 - 1x Dedicated (RED) SSO;
 - 1x Normal SSO;
 - 1x Euro socket outlet;
 - 1x Data outlet and 1x HDMI outlet
 - Wall box complete with:
 - 1x Dedicated (RED) SSO;
 - 1x Normal SSO;
 - 1x Euro socket outlet and 1x Data outlet
 - Data outlet mounted at 300mm AFFL or on power skirting as indicated
 - Data outlet mounted in ceiling void
 - Wi-fi outlet mounted in ceiling void
 - Projector
 - ø25mm PVC conduit
 - ø32mm Conduit riser
 - # - Indicates number of risers
 - # - Indicates number of risers

| Revisions: | | | |
|------------|-------------------|------------|----|
| Rev | Description | Date | By |
| 0 | Issued for Tender | 08.09.2022 | HP |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |

Standard Electrical Notes:

This drawing only shows the electrical installation requirements.

The subcontractor must consult the other drawings relevant to this section of the project to ensure that in fixing his work it will comply with the overall requirements of the visual design as shown on the architect's drawings and that it will not obstruct the fixing or future maintenance of other services.

The subcontractor is responsible with the main contractor for correct field dimensions, clearances and heights, quantities, fabrication processes and techniques of construction, co-ordination of his work with that of all other trades and for providing all devices necessary for safe and satisfactory operation.

Legend:



This drawing is based on Architects drawing No:
Refer to Schedule

DTM
MECHANICAL & ELECTRICAL
CONSULTING ENGINEERS

GAUTENG
S&P House, Cnr. Lenchen Avenue
North & South Street, Centurion
PO Box 7270, Centurion, 0046,
RSA
drawing@dtm-gauteng.co.za
info@dtm-gauteng.co.za

WESTERN CAPE
Tel: +27 (0) 21
423-6955/6

KWAZULU NATAL
Tel: +27 (0) 31 202-6244/6394

THIS DRAWING IS COPY RIGHT© PROTECTED


Project:

LETABA COLLEGE

Drawing Title:

Block C - Ground Floor - Voice and Data Layout

| Designed | Drawn | Checked | | Passed | Date | Size |
|------------------------------------|----------|---------|----------------|--------|------------|---------|
| CP | HP | Quality | Design | PR Eng | 09.12.2021 | A1 |
| | | SE | CP | CP | | Scale |
| | | | | | | 1 : 100 |
| Drawing Status : Issued for Tender | | | | | | |
| Project Number | Division | Service | Drawing Number | | Revision | |
| 211056 | E | VD | C4GF-VD | | 0 | |

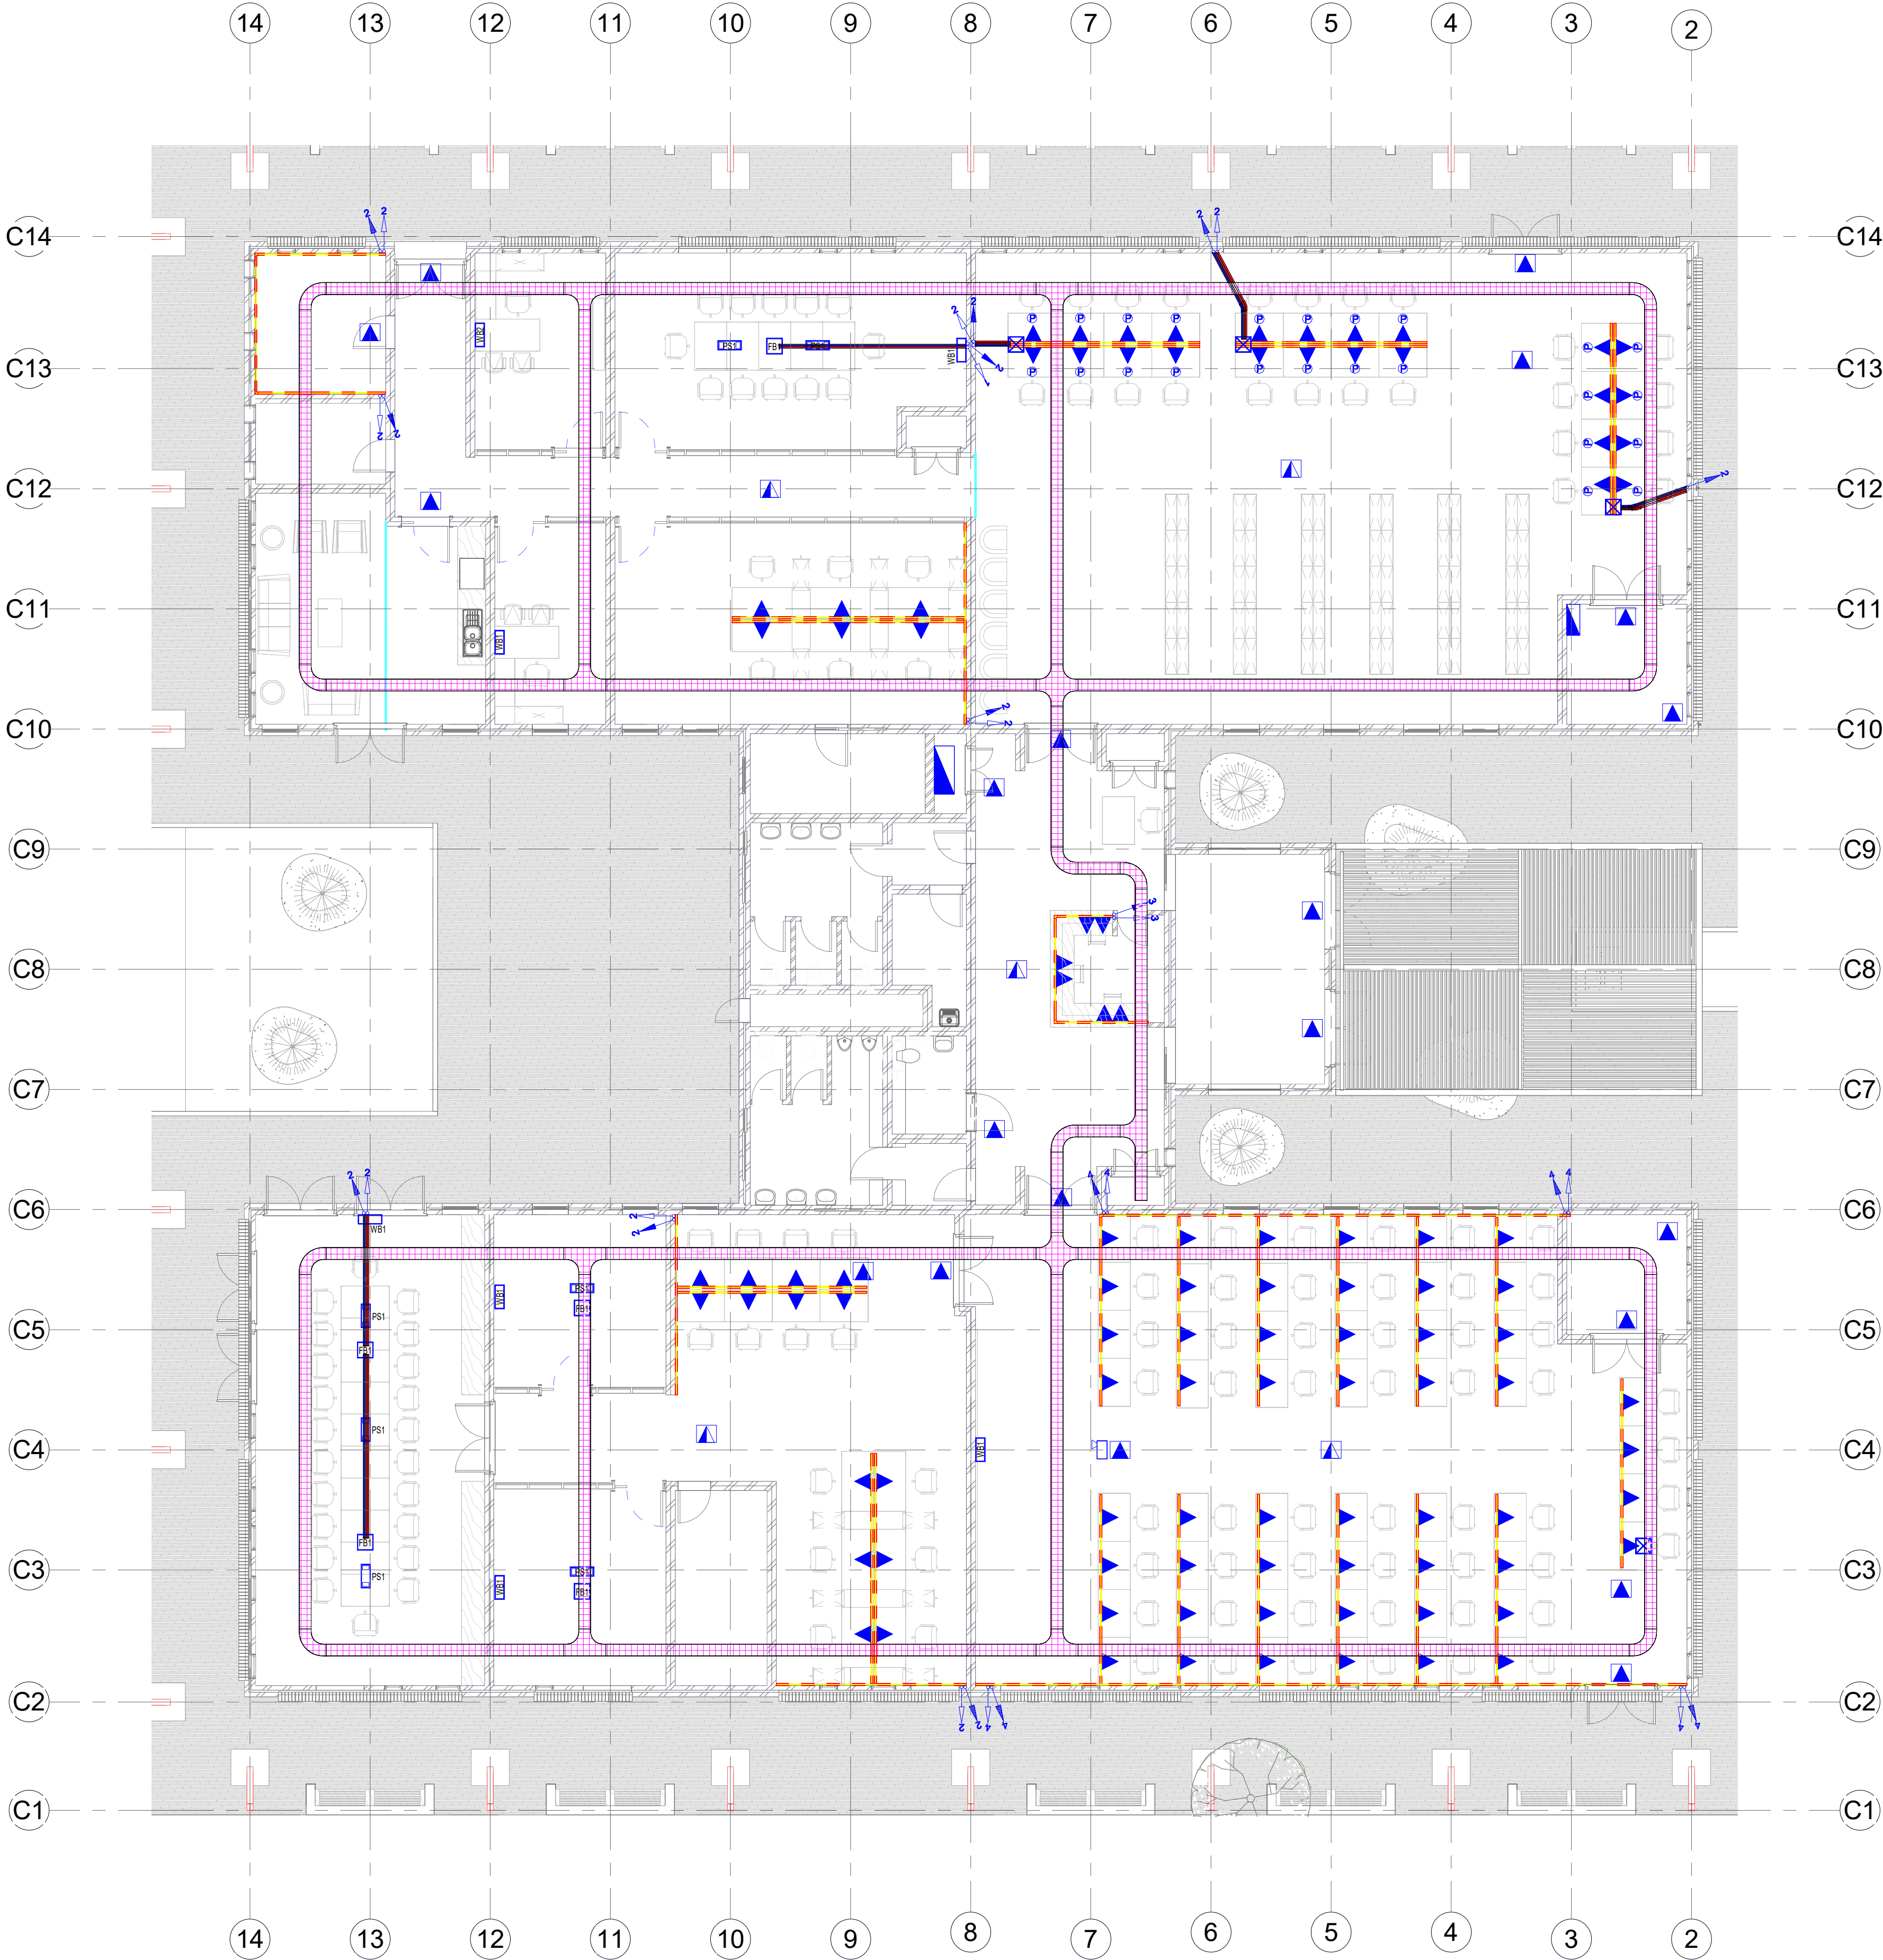

Building C - Ground Floor - Voice and Data Layout
1 : 100