




ADMIN BLOCK PLAN
SCALE 1:100

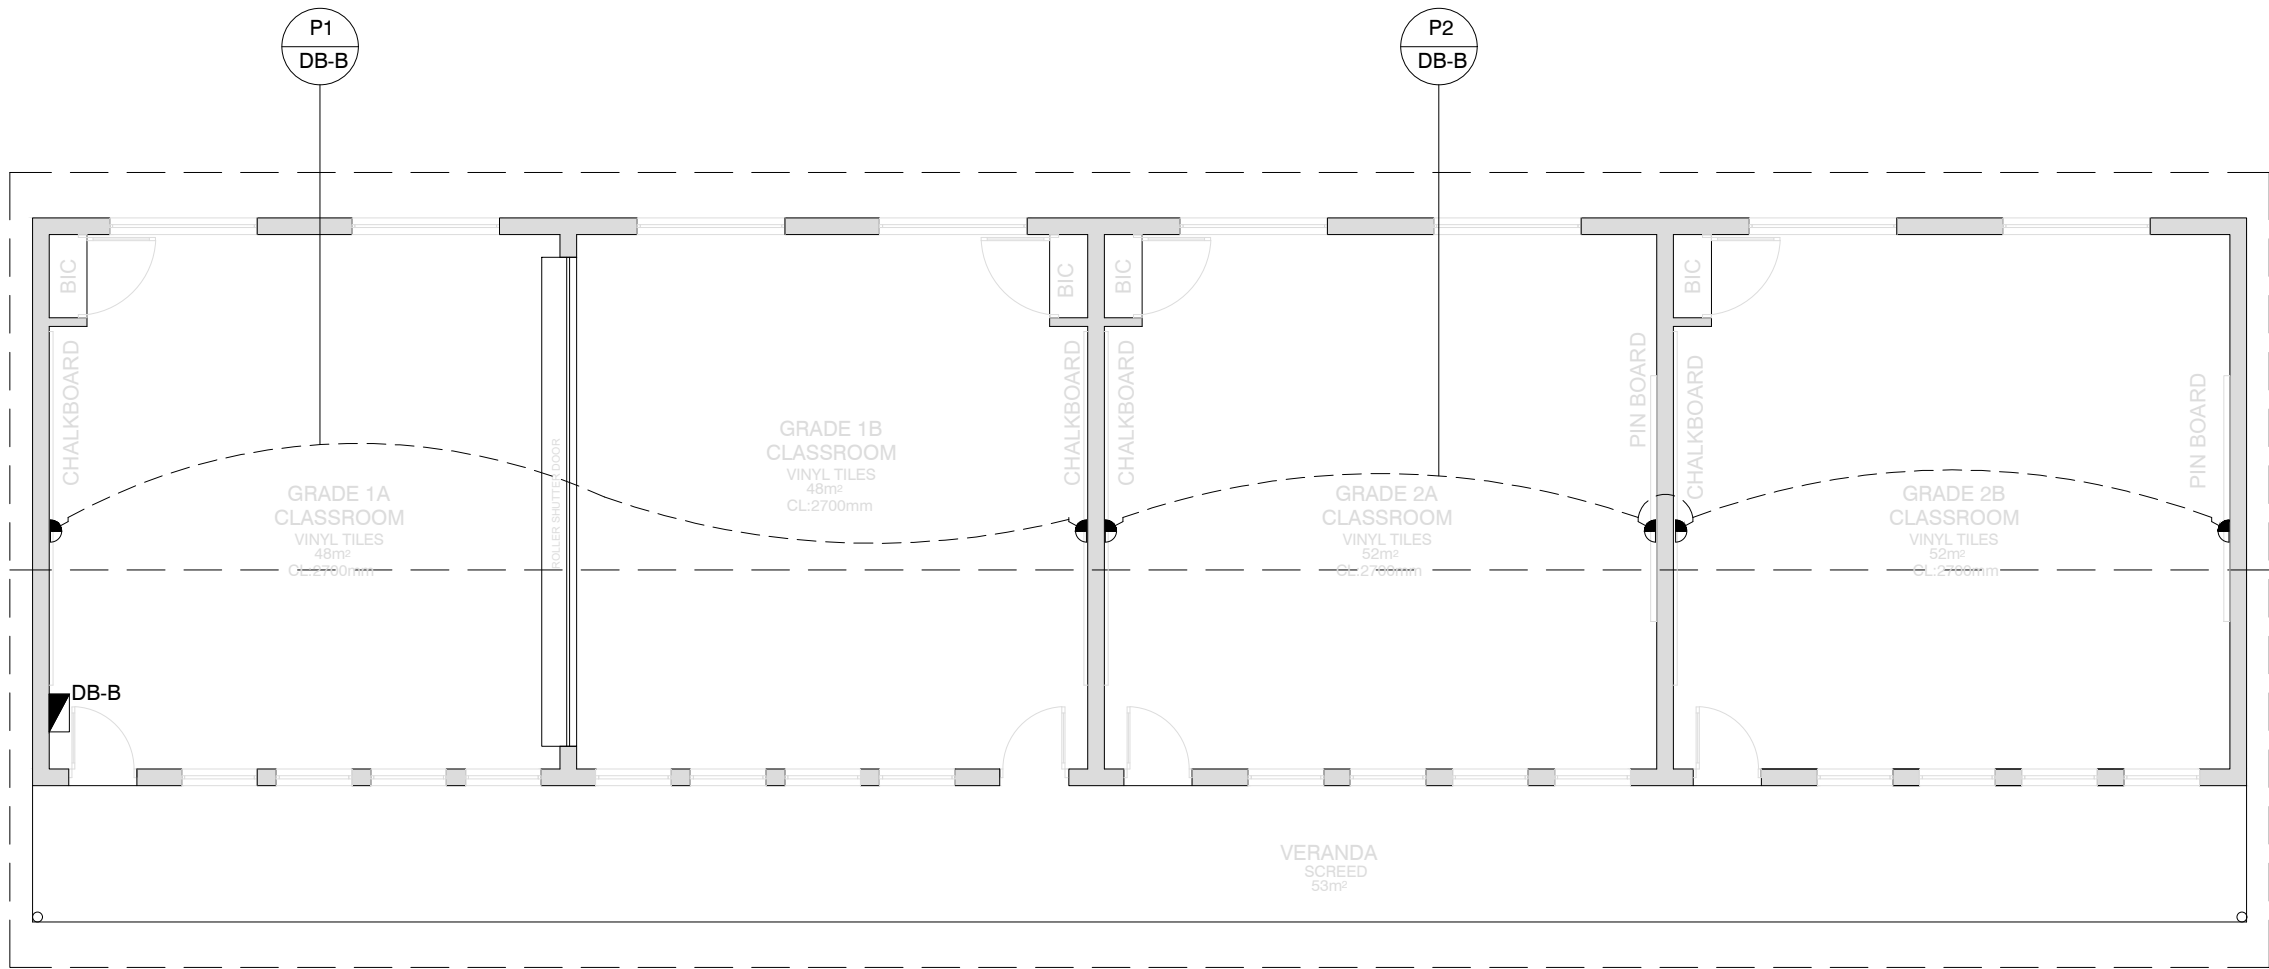


GRADE 1 & 2 CLASSROOM BLOCK PLAN
SCALE 1:100

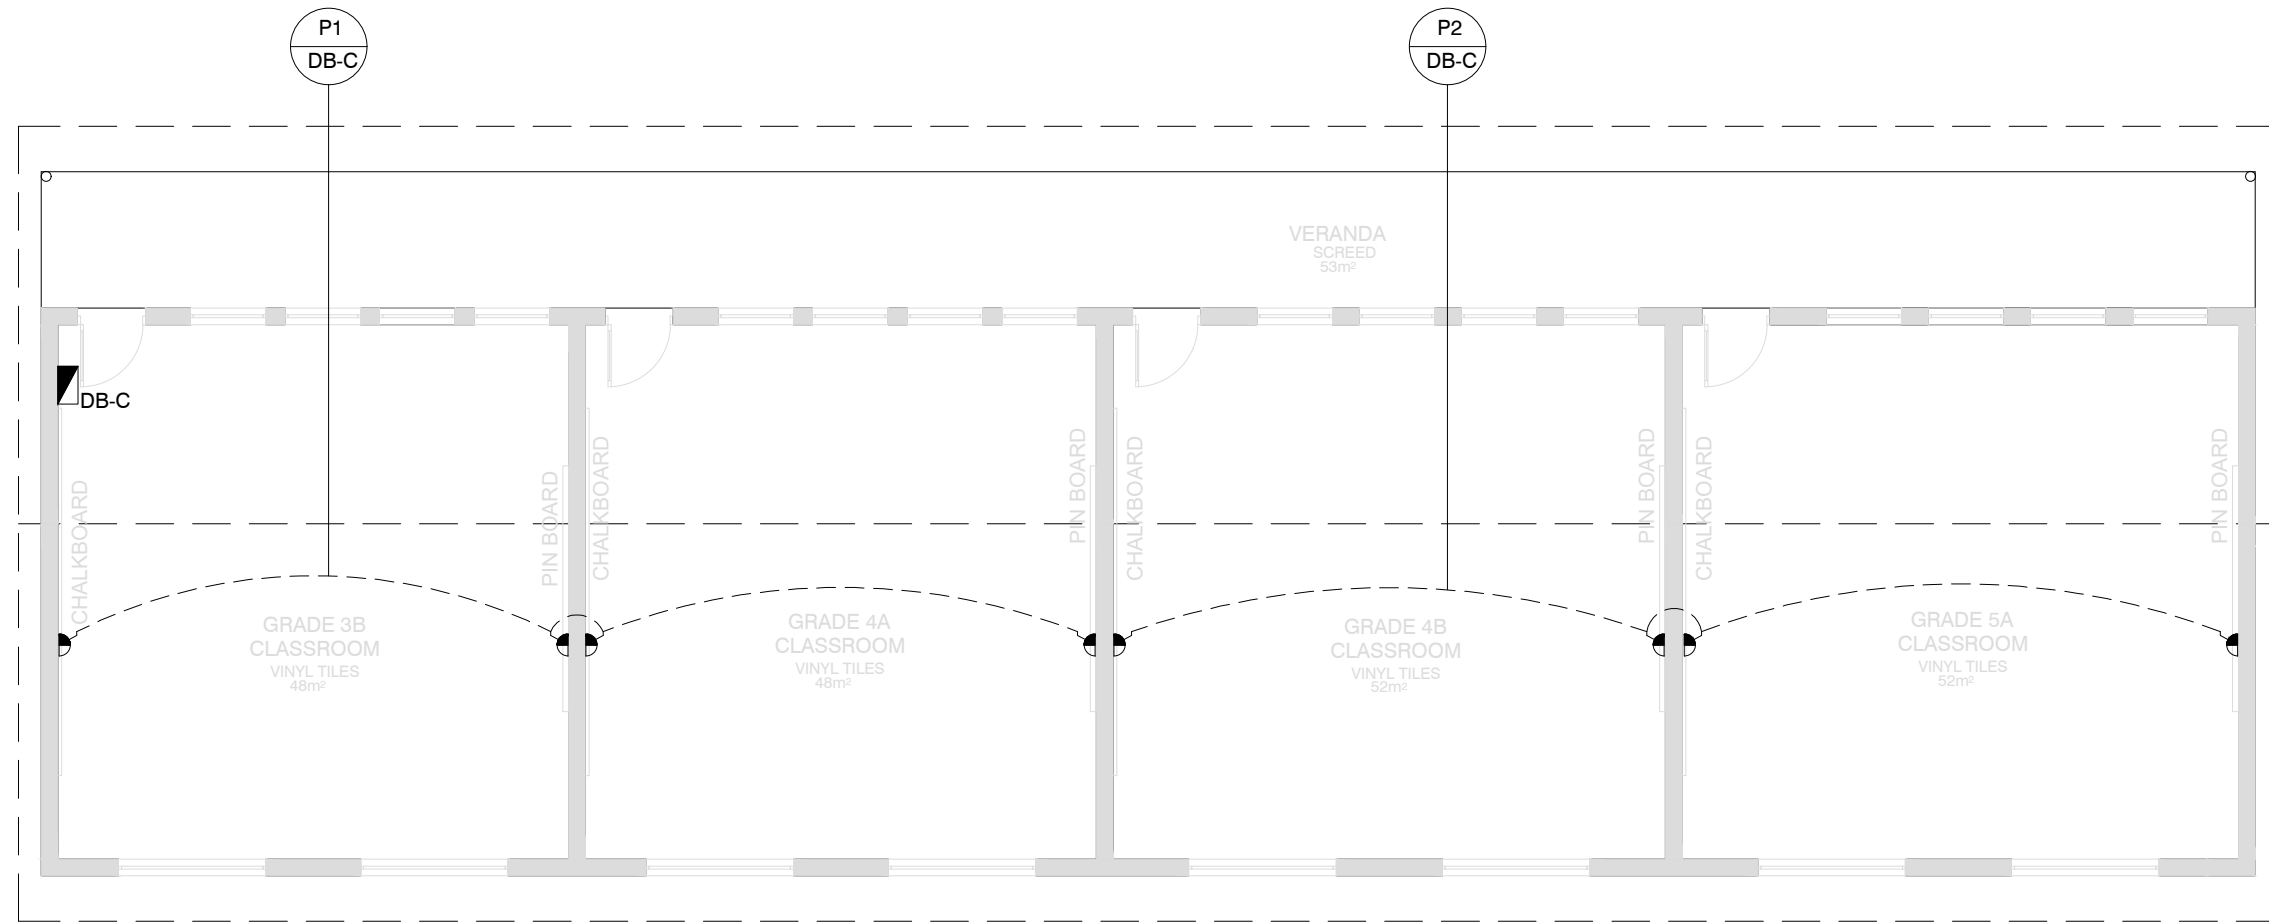

GRADE 4 CLASSROOM BLOCK PLAN
SCALE 1:100

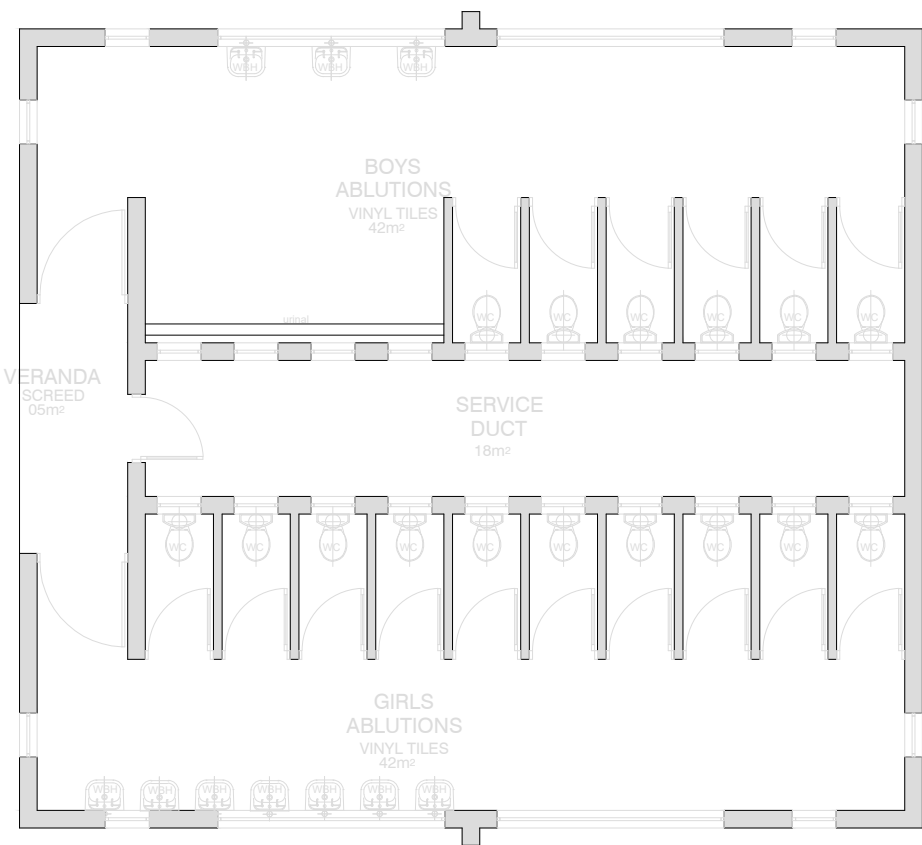

BOYS & GIRLS ABLUTIONS PLAN
SCALE 1:100

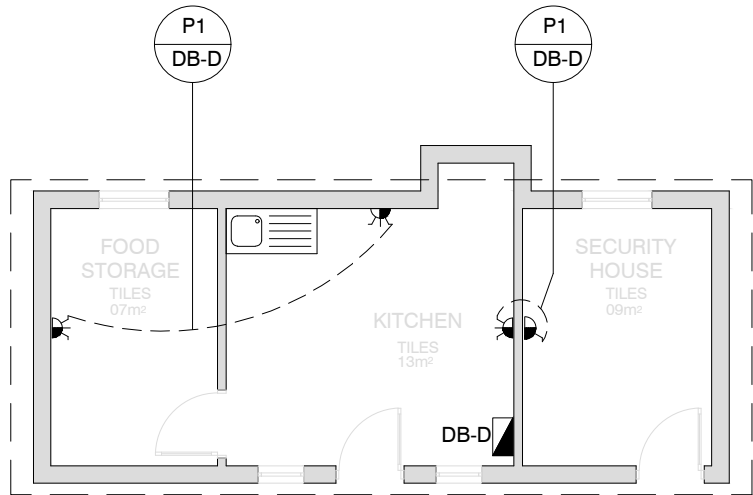

KITCHEN & SECURITY HOUSE PLAN
SCALE 1:100

| LEGEND: | |
|---|---|
| | NEW 16amp STANDARD SOCKET 3 PIN SWITCH SOCKET OUTLETS BEARING THE SABS MARK MOUNTED 300mm A.F.F.L. ON POWER SKIRTING. 16amp NORMAL SSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE 2.5mm ² BEW. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | NEW 16amp STANDARD SOCKET 3 PIN SWITCH SOCKET OUTLETS BEARING THE SABS MARK MOUNTED 300mm A.F.F.L. ON WALL. 16amp NORMAL SSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE 2.5mm ² BEW. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | NEW 16amp STANDARD 3 PIN DOUBLE SWITCH SOCKET OUTLETS BEARING THE SABS MARK MOUNTED ON WALL 200mm A.F.F.L. 16amp NORMAL DSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE 2.5mm ² BEW ON WALL. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | NEW 16amp DEDICATED 3 PIN SWITCH SOCKET OUTLETS BEARING THE SABS MARK - ISOLATED EARTH PIN SHAVED AT 90° CHAMFERED EARTH. 1. 16amp 3 PIN SHAVED SSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE & 2.5mm ² PVC GREEN INSULATED EARTH MOUNTED ON A POWER SKIRTING. 2. NO EARTH LEAKAGE FOR THIS CIRCUIT. 3. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | NEW 16amp DEDICATED 3 PIN SWITCH SOCKET OUTLETS BEARING THE SABS MARK - ISOLATED EARTH PIN SHAVED AT 90° CHAMFERED EARTH. 1. 16amp 3 PIN SHAVED SSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE & 2.5mm ² PVC GREEN INSULATED EARTH MOUNTED ON WALL. 2. NO EARTH LEAKAGE FOR THIS CIRCUIT. 3. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | NEW 16amp STANDARD SOCKET 3 PIN, 1x2 PIN SWITCH SOCKET OUTLETS BEARING THE SABS MARK MOUNTED ON WALL 200mm A.F.F.L. 16amp NORMAL SSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE 2.5mm ² BEW. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | NEW 16amp STANDARD SOCKET 3 PIN, 1x2 PIN SWITCH SOCKET OUTLETS BEARING THE SABS MARK MOUNTED ON WALL 200mm A.F.F.L. 16amp NORMAL SSO's TO BE WIRED WITH 2 x 4.0mm ² (L+N) PVC WIRE 2.5mm ² BEW. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. 20amp SP 5kg CB IN DISTRIBUTION BOARD FOR PROTECTION. |
| | DISTRIBUTION BOARD MOUNTED 2200mm A.F.F.L. TO TOP OF DISTRIBUTION BOARD |
| NOTES: 1. MOUNTED 300mm ABOVE COUNTER TOP. | |

| No. | DATE | AMENDMENT | D.P.W. |
|---|------|-----------|--------|
| | | | |
| Copyright vests in the Department of Public Works | | | |
| as-built drawings | | | |
| certified as-built drawings as per Centralised Drawing Archive AS-BUILT DRAWING REQUIREMENTS | | | |
| name: _____ | | | |
| date: _____ | | | |
| professional registration no.: _____ | | | |



| | | | |
|--|------------|----------|--------|
| discipline | ELECTRICAL | | |
| service | | | |
| drawing title | | | |
| KZN D.O.E. INFRASTRUCTURE DEVELOPMENT AND MAINTENANCE PROGRAM | | | |
| INKONKONI PRIMARY SCHOOL EXISTING ADMIN, GRADE 1 & 2, GRADE 4, ABLUTIONS AND KITCHEN & SECURITY POWER LAYOUT PLAN | | | |
| ref.no. | 000000 | designed | 000000 |
| scale | 1:100 | drawn | LM |
| date | JAN 2023 | checked | MM |
| drawing number | | | REV |
| D19001-500-0003 | | | 00 |

ISSUED FOR TENDER