




ADMIN BLOCK PLAN
SCALE 1:100

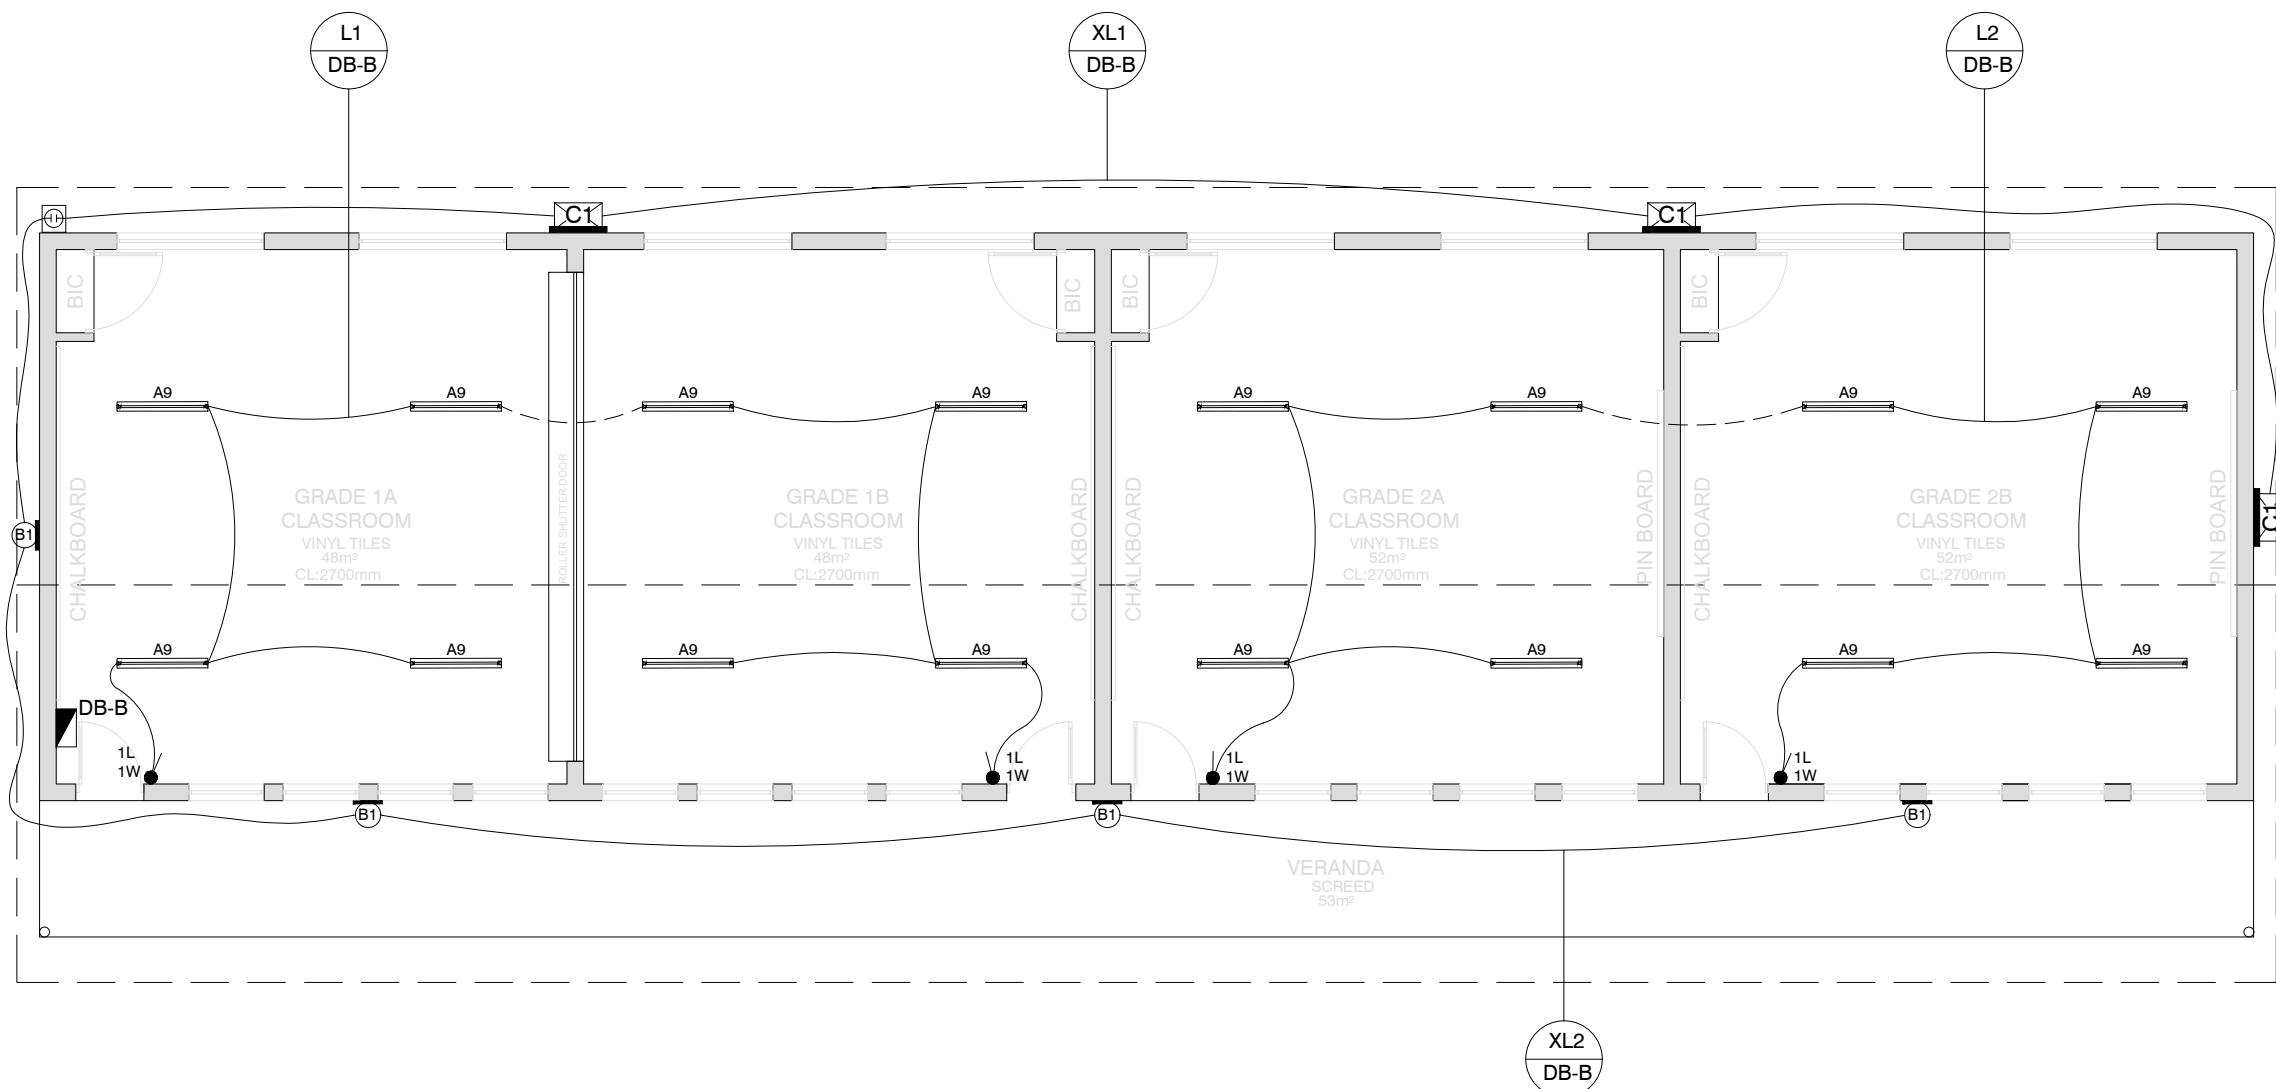


GRADE 1 & 2 CLASSROOM BLOCK PLAN
SCALE 1:100

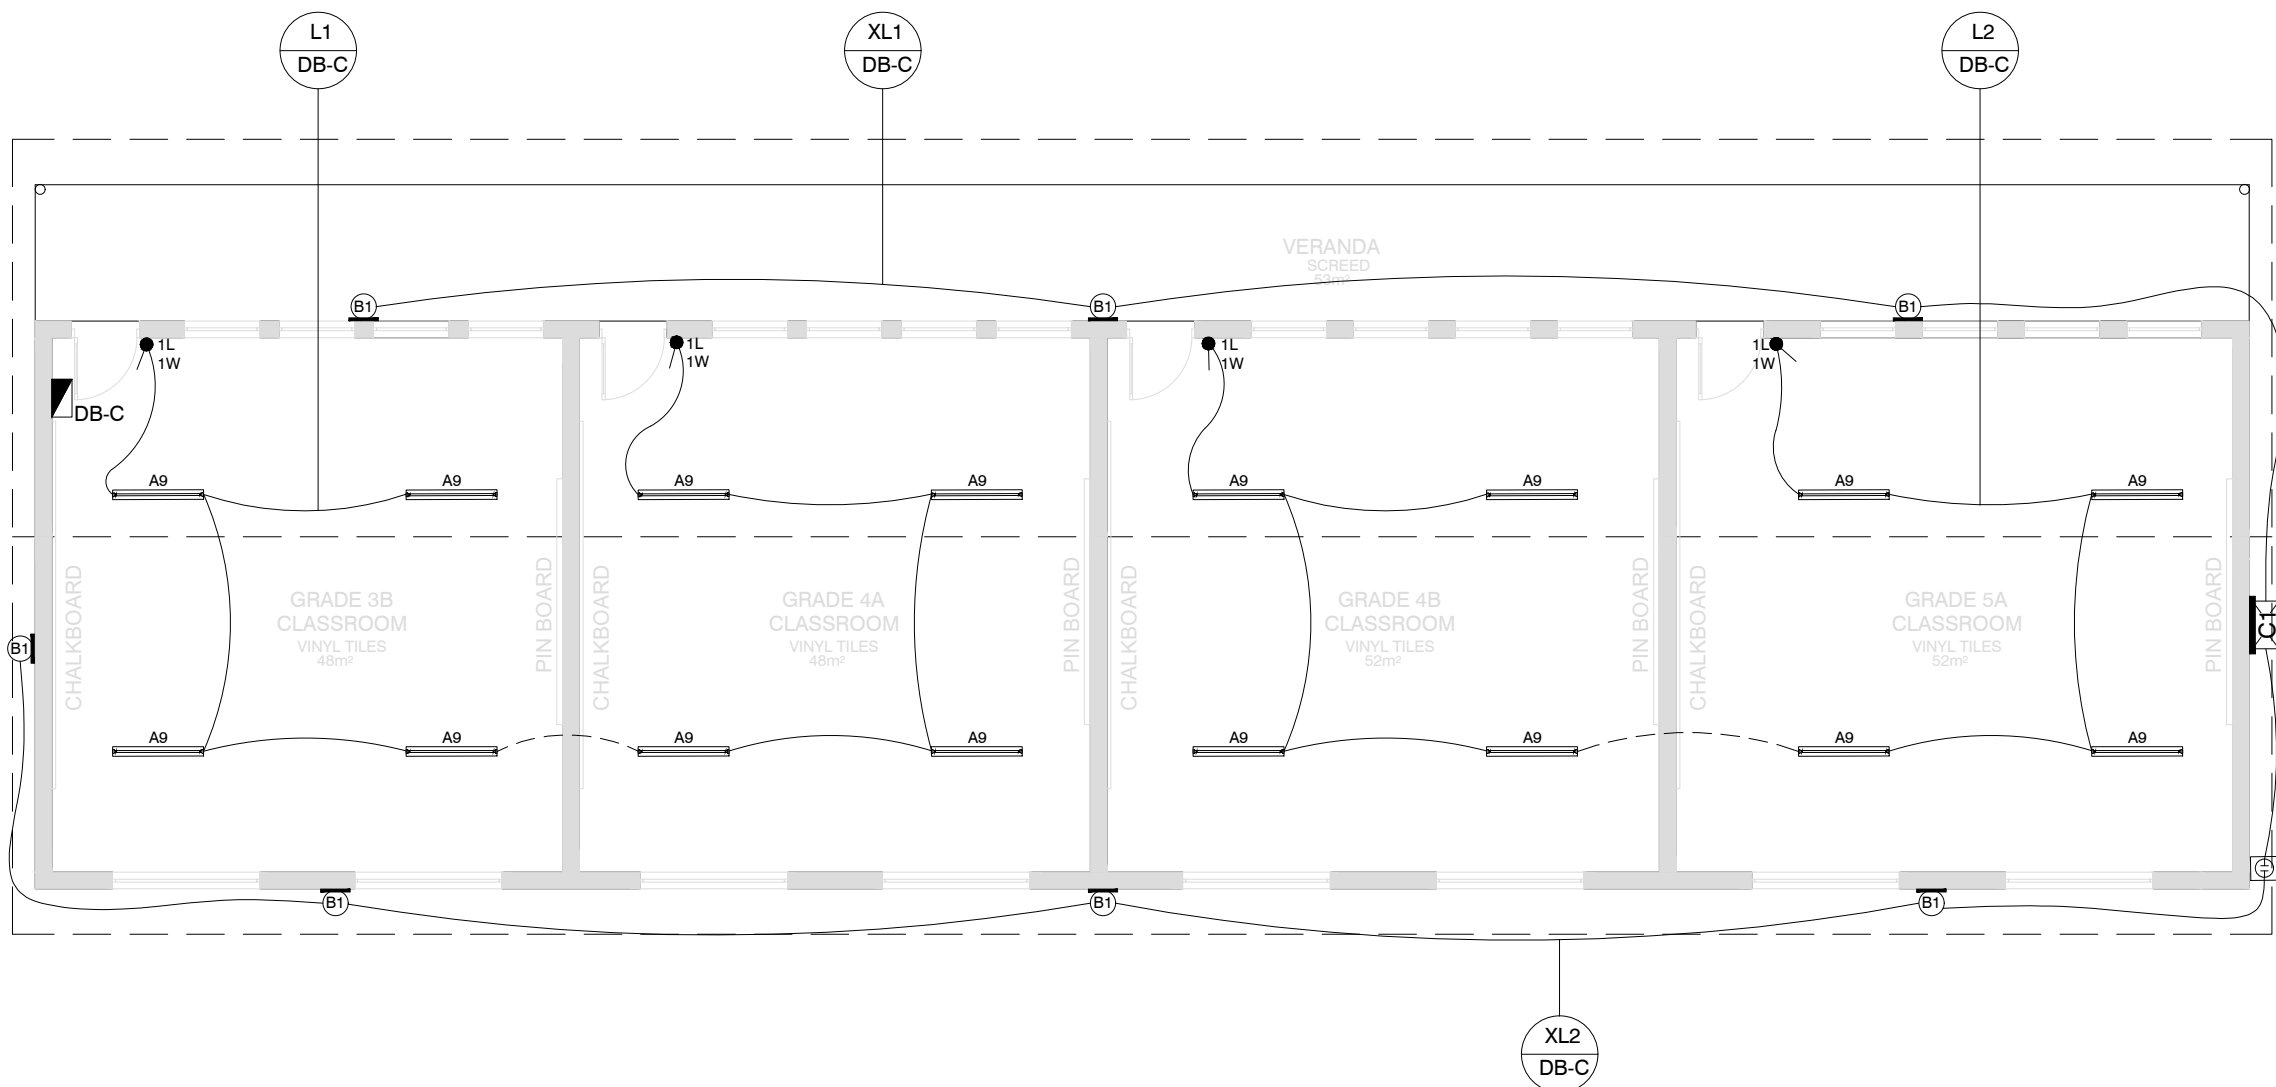

GRADE 4 CLASSROOM BLOCK PLAN
SCALE 1:100

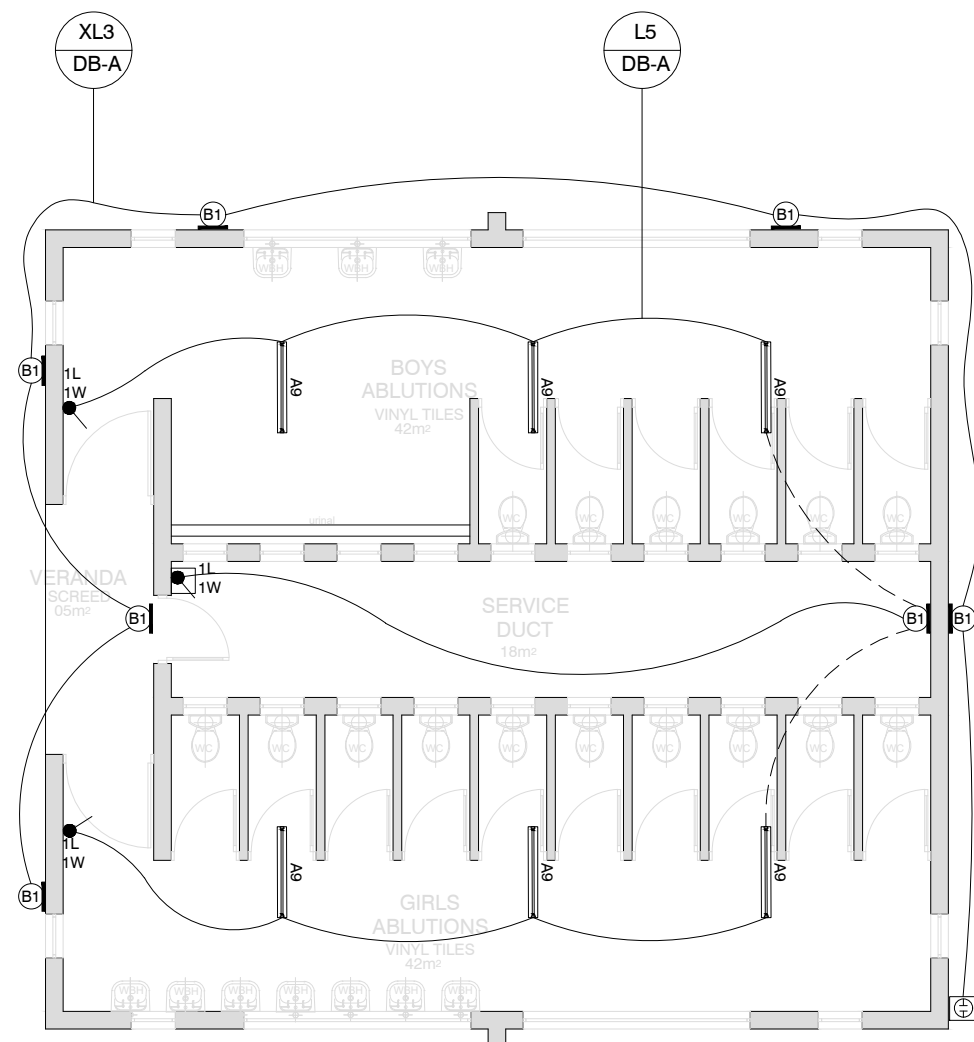

BOYS & GIRLS ABLUTIONS PLAN
SCALE 1:100

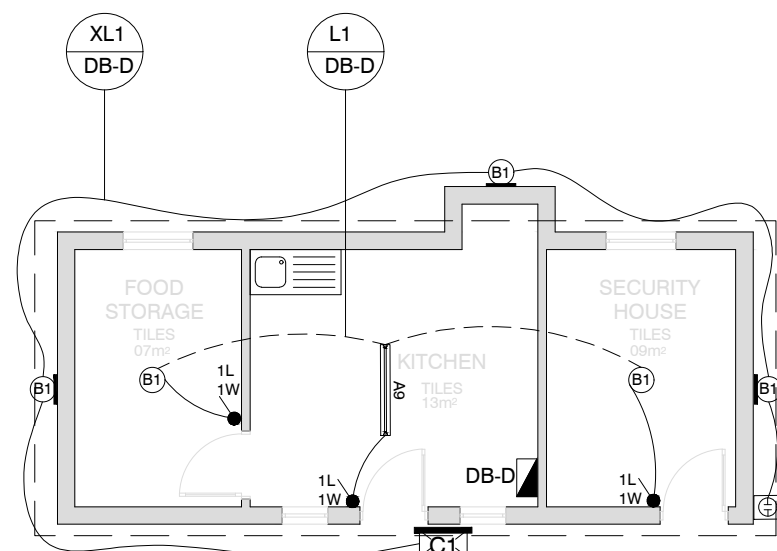

KITCHEN & SECURITY HOUSE PLAN
SCALE 1:100

LEGEND	
	DISTRIBUTION BOARD MOUNTED 2200mm A.F.F.L TO TOP OF DB
	TYPE 9 SURFACE MOUNTED IP65 DIE-CAST ALUMINIUM BODY LUMINAIRE (1200mm) COMPLETE WITH LED 20W LAMP (± 2800LUMEN PER LAMP) 4000K, MINIMUM OF 25 000 OPERATING HOURS.
	TYPE B1 SURFACE MOUNTED BULKHEAD COMPLETED WITH ELECTRONIC GEAR AND LED 20W (± 2000LUMEN) 4000K, MINIMUM OF 50 000 OPERATING HOURS.
	TYPE B1 SURFACE MOUNTED BULKHEAD COMPLETED WITH ELECTRONIC GEAR AND LED 20W (± 2000LUMEN) 4000K, MINIMUM OF 50 000 OPERATING HOURS.
	TYPE C1 WALL MOUNTED FLOODLIGHTS 80W (± 10000LUMEN) 4000K, MINIMUM OF 100 000 OPERATING HOURS.
	1 LEVER 1 WAY LIGHT SWITCH MOUNTED 1400mm A.F.FL
	2 LEVER 1 WAY LIGHT SWITCH MOUNTED 1400mm A.F.FL
	IP65 WEATHER PROOF 1 LEVER 1 WAY LIGHT SWITCH MOUNTED 1400mm A.F.FL
	PHOTOCELL

NOTES:
1. FLOODLIGHT TO BE MOUNTED ON THE EXISTING POLE ABOVE/ THROUGH THE ROOF.
2. FLOODLIGHT TO BE MOUNTED ON A NEW 1200mm POLE MOUNTED ON WALL THROUGH THE ROOF.

No.	DATE	AMENDMENT	D.P.W.
Copyright vests in the Department of Public Works			
as-built drawings			
certified as-built drawings as per Centralised Drawing Archive AS-BUILT DRAWING REQUIREMENTS			
name: _____			
date: _____			
professional registration no.: _____			



discipline	ELECTRICAL		
service			
drawing title			
KZN D.O.E. INFRASTRUCTURE DEVELOPMENT AND MAINTENANCE PROGRAM			
INKONKONI PRIMARY SCHOOL			
EXISTING ADMIN, GRADE 1 & 2, GRADE 4, ABLUTIONS AND KITCHEN & SECURITY LIGHTING LAYOUT PLAN			
ref.no.	000000	designed	000000
scale	AS INDICATED	drawn	LM
date	JAN 2023	checked	MM
drawing number			REV
D19001-500-0001			00