


A/C NOTES:

- 1) ALL EXPOSED DUCTING TO HAVE MEZZ OR EQUAL FLANGES.
- 2) ALL DUCTING WITH SEMI PERIMETER >1150mm TO HAVE MEZZ OR EQUAL FLANGE.
- 3) EXPOSED DUCTING TO BE PAINTED IN ACCORDANCE WITH STANDARD QUALITY SPECIFICATIONS.
- 4) ALL SUPPLY & RETURN AIR DUCTING TO BE EXTERNALLY INSULATED WITH 25mm F.R.K. FOL-FACED FIBREGLASS. (UNLESS NOTED OTHERWISE)
- 5) ALL DUCT PENETRATIONS THROUGH WALLS <25mm HARDWOOD FRAME - BY BUILDER.

SYMBOL LEGEND	
	ISOLATOR AND ELECTRICAL SUPPLY: 380 VOLT/3-PHASE
	INDICATED DB BOARD
	ELECTRICAL POWER SUPPLY: 220V/SINGLE PHASE
	WALL BOX: 100 X 100 WITH 25 CONDUIT TO PANEL
	OPENING THROUGH WALL: 50mm LARGER THAN DUCT
	OPENING THROUGH WALL WITH 25mm HARDWOOD FRAME
	DOORS TO BE UNDERCUT BY 20mm
	MAINS WATER SUPPLY WITH GATE VALVE-SIZE AS NOTED
	DRAIN NB 100, CONNECTED INTO SEWER SYSTEM
	FIRE RELAY - BY FIRE PROTECTION CONTRACTOR
	STARTER WITH OVERLOAD PROTECTION - BY AIR CONDITIONING CONTRACTOR
	FIRE DAMPER - MOTORISED SPRING RETURN
	UNINSULATED DUCTING
	INTERNALLY INSULATED DUCTING
	EXTERNALLY LAGGED DUCTING
	REMOTE ON/OFF SWITCH - 100 X100 WALL BOX WITH 25mm CONDUIT INTO CEILING VOID
	BMS TEMPERATURE SENSOR
	THERMOSTAT (MASTER DIFFUSER)

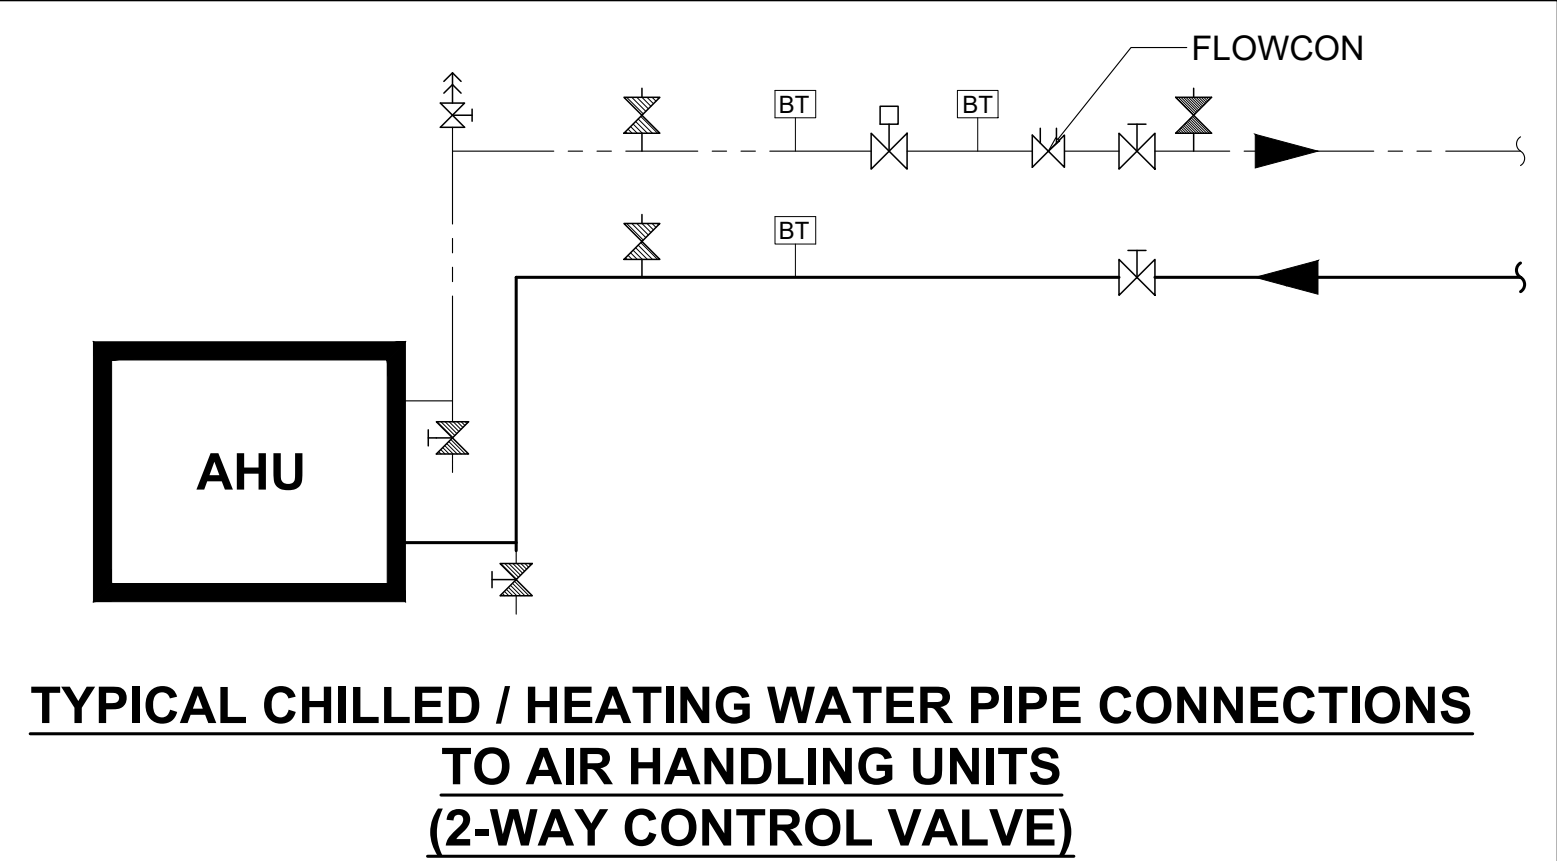

PIPING LEGEND:			
	BUTTERFLY VALVES		
	ISOLATING VALVE		
	SAUNDERS VALVE / BALANCING VALVE		
	CHECK VALVES		
	MOTORISED VALVE		
	THREE-WAY VALVE		
	FLOWCON VALVE		
	FLOW SWITCH - 20		
	STRAINER WITH 32 BALL VALVE - DRAIN		
	BINDER TEST POINT - 10		
	FLEXIBLE COUPLING		
	SIGNET FLOW METER - 50		
	BMS TEMP POINT - 15		
	SUMMIT POINT - 20		
	DRAIN POINT - AHU/LS - 20		
	CHILLERS - 20		
	THERMOMETER WELL ONLY - 20		
	WATER TREATMENT SOCKET AND BALL VALVE - 20		
	WATER TREATMENT DOSING POT SOCKET AND BALL VALVE - 20		
	FLOW CONTROL METER		
	DIFFERENTIAL PRESSURE SENSOR		
	PRESSURE GAUGE		
	kW HR ENERGY METER		
	AUTOMATIC AIR VENT		
	STRIBE AND BALL VALVE FOR PRESSURE TEST POINT - 150		

GENERAL NOTES:

1) All boundaries, dimensions and levels are to be checked on site before construction and any discrepancies are to be reported to the Architect.

Partial Service: Any discrepancies with site or other information is to be advised to the Architect and direction or approval is to be sought before the implementation of the detail.

Do not scale this drawing.

For the purpose of coordination, all relevant parties must check this information prior to implementation and report any discrepancies to the Architect.

FOR TENDER

REVISIONS			
NO.	DATE	DESCRIPTION	REV. BY.
© COPYRIGHT: THIS DRAWING MAY NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS IN PART OR IN WHOLE WITHOUT THE PERMISSION OF THE DESIGNER. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH SANS CODE 1000, N.B. & LOCAL AUTHORITY BYLAW. USE FIGURED DIMENSIONS ONLY - DO NOT SCALE. ANY CONSTRUCTION FROM THESE DRAWINGS IS AT OWNER'S RISK.			
ALL BOUNDARIES, DIMENSIONS AND LEVELS ARE TO BE CHECKED ON SITE BEFORE CONSTRUCTION AND ANY DISCREPANCIES ARE TO BE REPORTED TO THE ARCHITECT. PARTIAL SERVICE: ANY DISCREPANCIES WITH SITE OR OTHER INFORMATION IS TO BE ADVISED TO THE ARCHITECT AND DIRECTION OR APPROVAL IS TO BE SOUGHT BEFORE IMPLEMENTATION OF THE DRAWING.			
FOR THE PURPOSE OF COORDINATION, ALL RELEVANT PARTIES MUST CHECK THIS INFORMATION PRIOR TO IMPLEMENTATION AND REPORT ANY DISCREPANCIES TO THE ARCHITECT.			
Mechanical Engineer: Ganny Govender Signature: _____ Date: _____			
 Solutions For The Built Environment			
PTA Office: 238 Large Street, New Middelburg Street, Brooklyn, Pretoria 0180 Tel: (+27) 12 346 8876			
Client: Government Printing Works Signature: _____ Date: _____			
PROJECT: ERF 3265, Pretoria Central, Government Printing Works ADDRESS: 379 Schubart St, Pretoria Central, Pretoria, 0002, RSA.			
DRAWING TITLE: GROUND FLOOR AIRCONDITIONING & VENTILATION LAYOUT			
BUILDING CLASSIFICATION: G1		CLIMATIC ZONE: 2	
Paper Size: A0		SCALE: 1 : 50	
Drawn: LM		Checked: GG	
DATE: 11/12/2017		DATE: 11/12/2017	
PROJECT No: GP17-006		REVISION: T0	
DRAWING No: M-1001			