


- Electrical Notes**
1. ALL CONDUIT RECESSED SABS APPROVED PVC WITH GALVANISED OUTLET BOXES (EXCEPT 50 DIA ROUND TO BE PVC).
  2. HEIGHTS ABOVE FINISHED FLOOR LEVEL SHOWN TO BOTTOM OF OUTLETS/EQUIPMENTS.
  3. ALL EQUIPMENT TO BE SUPPLIED AS SPECIFIED. NO ALTERNATIVES TO BE TENDERED.
  4. ALL LIGHT SWITCHES MOUNTED AT 1400mm AFPL UNLESS OTHERWISE SPECIFIED.
  5. ALL OUTLETS, WIRING AND CONDUITS TO BE INSTALLED BY ELECTRICAL CONTRACTOR.
  6. SOCKET OUTLETS MOUNTED AT 300mm AFPL UNLESS OTHERWISE SPECIFIED.
  7. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELATED DRAWINGS FOR CO-ORDINATION PURPOSES.

**ELECTRICAL LEGEND:**

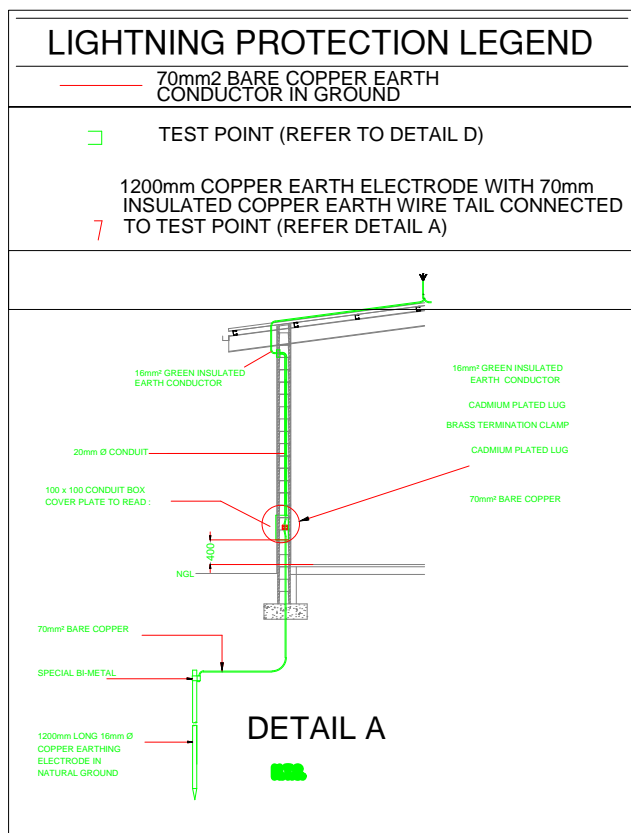

Signature by the Client department

Development Bank of Southern Africa  
Headway Hill 1258 Lever Road,  
Midrand South Africa  
P O Box 1234  
Halfway House 1685  
Tel: +27 11 313 3911  
Email: webmaster@dbsa.org



Revisions			
Rev. No.	Date	Description	Rev. by

CHECKED BY CONSULTANT  
NAME

SIGNATURE Date

CONSULTANT  
Deedscon Consult (Pty) Ltd  
52 Panorama Road  
Rooihuskraal  
Centurion  
0157  
Tel: +27 12 655 0994  
Email: info@deedscon.co.za



PROVINCE OF KWAZULU NATAL  
DEPARTMENT  
OF  
EDUCATION  
HEAD: EDUCATION

PROJECT DEPARTMENT OF EDUCATION:  
KING CETSHWAYO DISTRICT MUNICIPALITY  
PROPOSAL - UPGRADES & ADDITIONS  
AT NKOSITHANDILE SECONDARY SCHOOL

DRAWING DESCRIPTION  
FIVE CLASS ROOM BLOCK  
EARTHING & LIGHTNING  
PROTECTION

PROJECT No.		DRAWING No.		REVISION
1905-04		EE-EL-02		0
SCALE	DATE	DESIGNED/DRAWN	CHECKED	
N.T.S	Sep 2022	T.M	A.M	

NKOSITHANDILE SEC. SCHOOL