



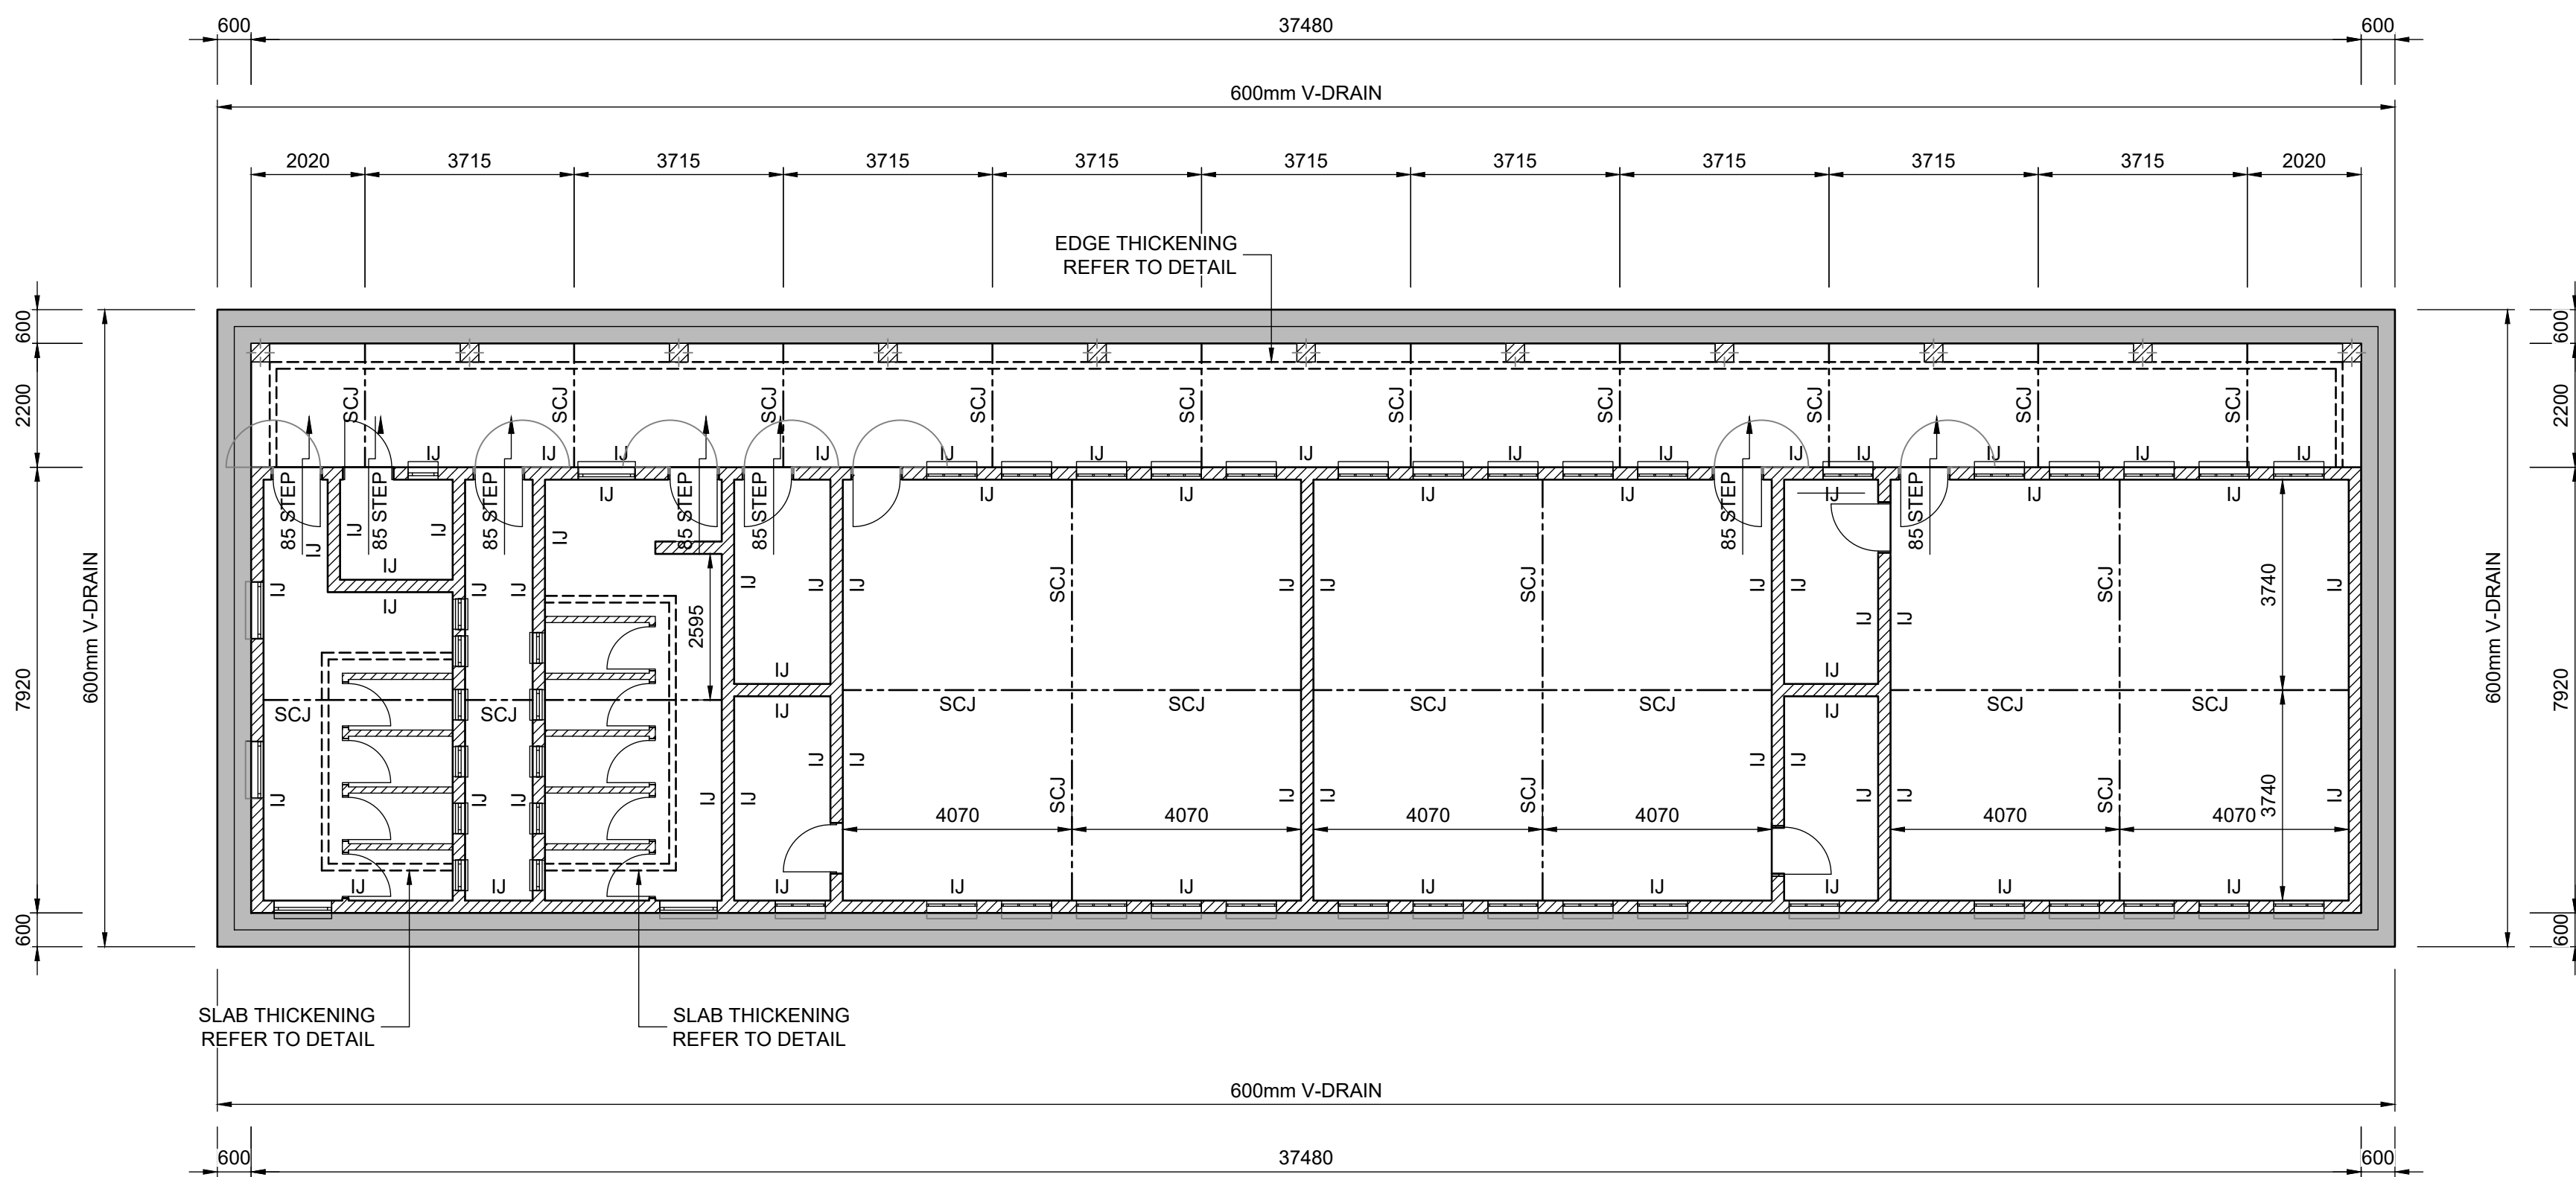


CLASSROOM BLOCKS A AND C WITH ABLUTIONS: SURFACE BED LAYOUT

2 No. OFF
SCALE 1:100

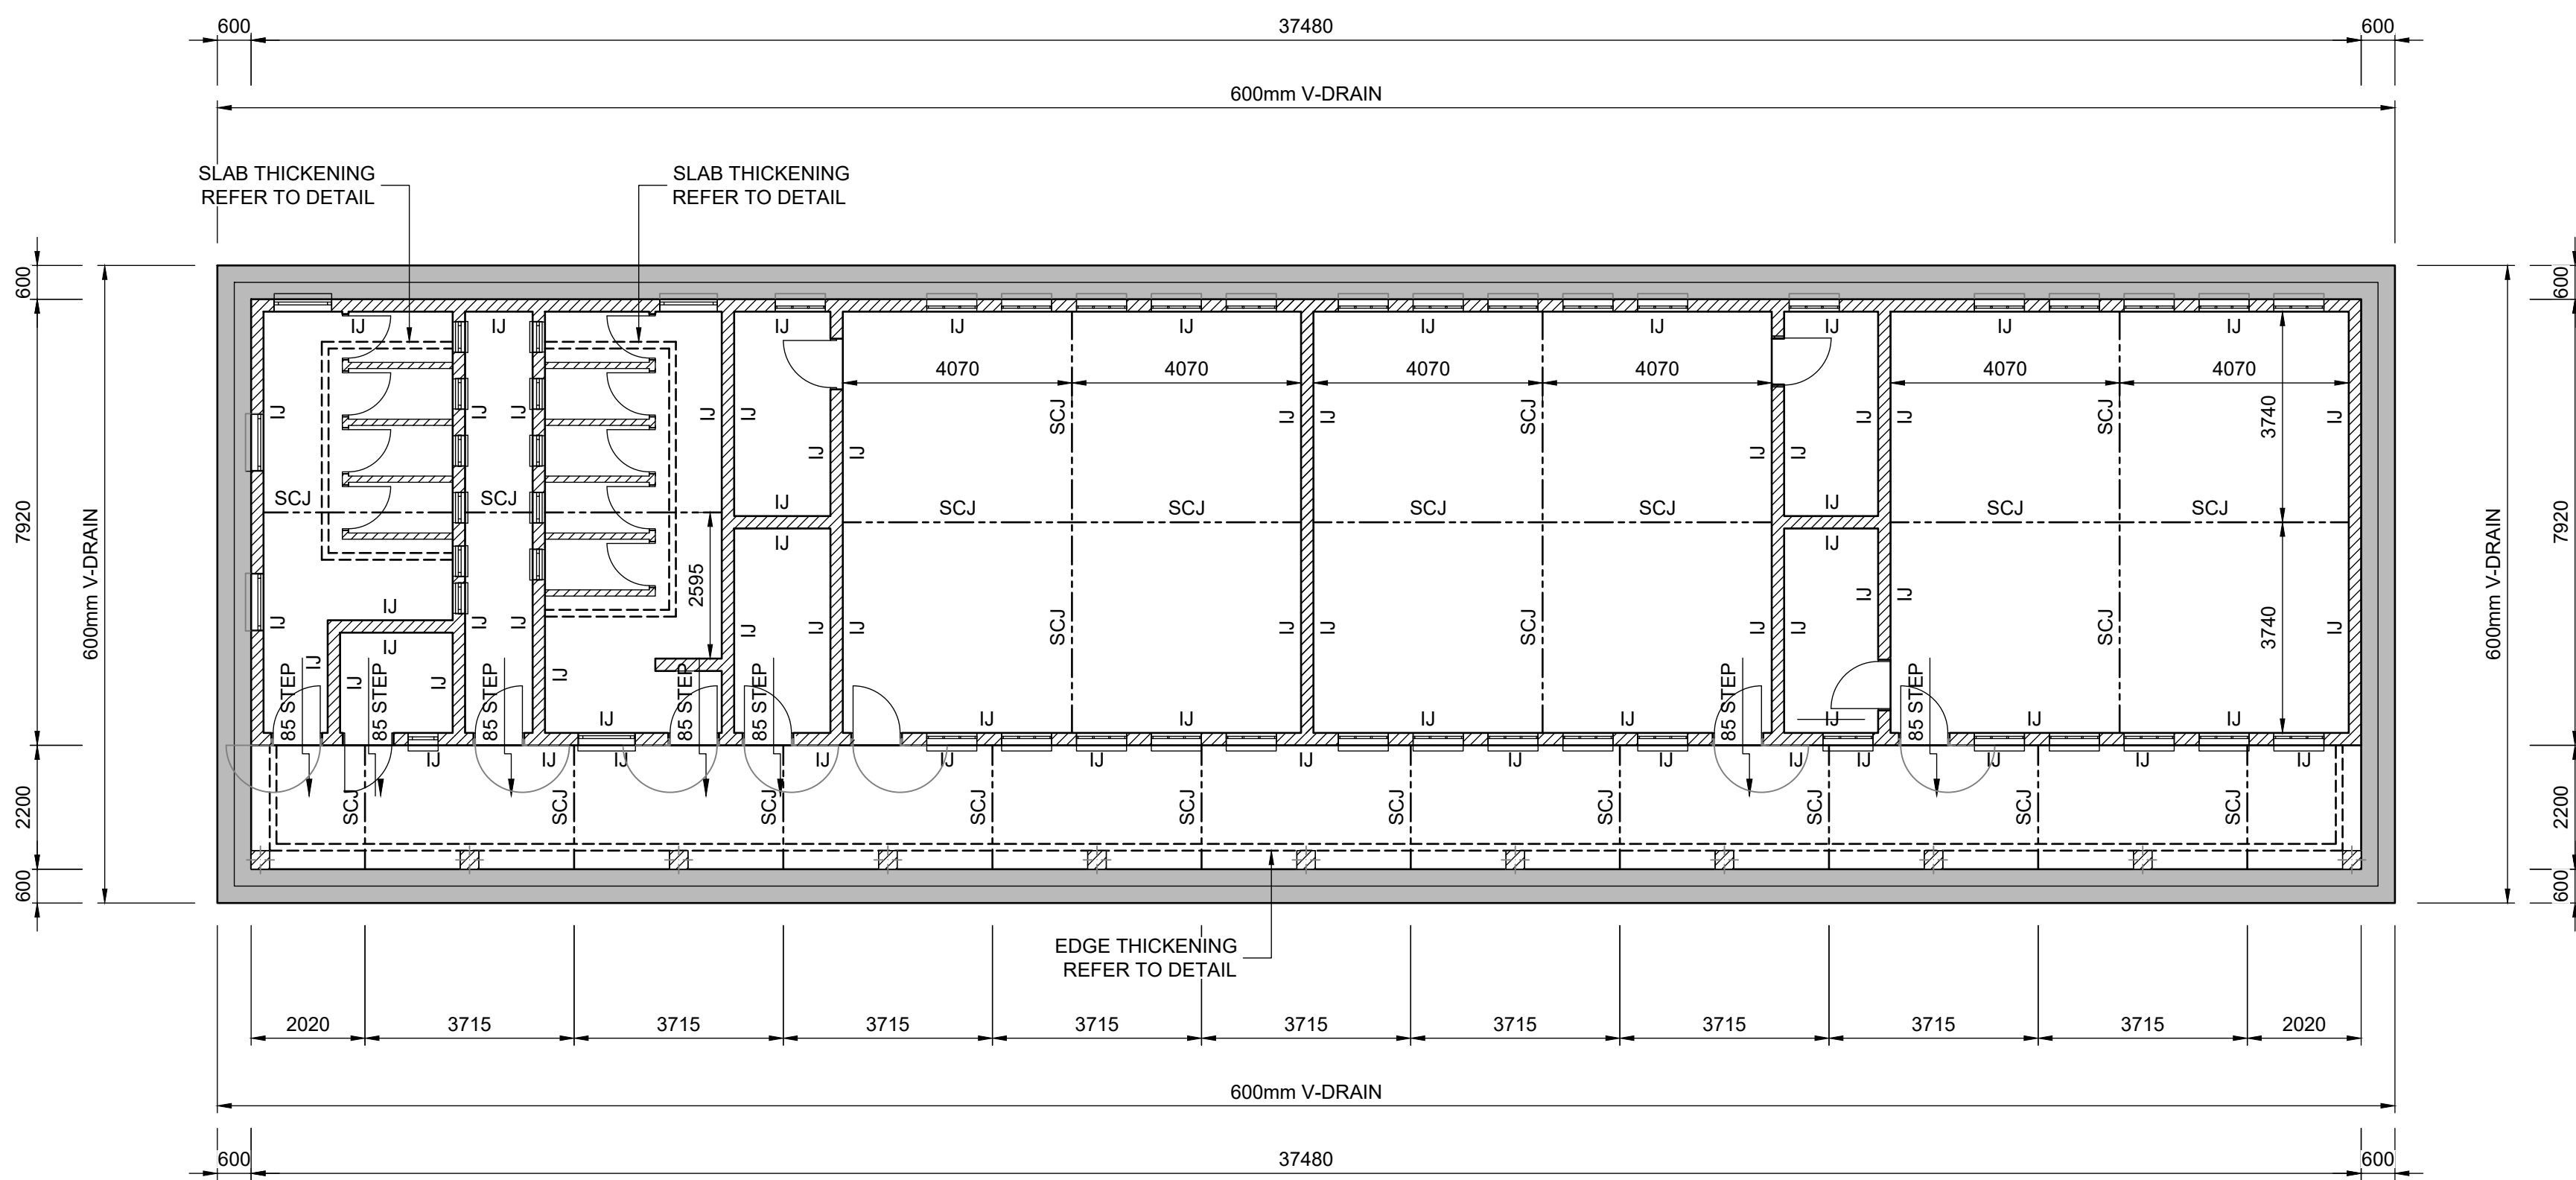


CLASSROOM BLOCKS E AND G WITH ABLUTIONS: SURFACE BED LAYOUT

2 No. OFF
SCALE 1:100

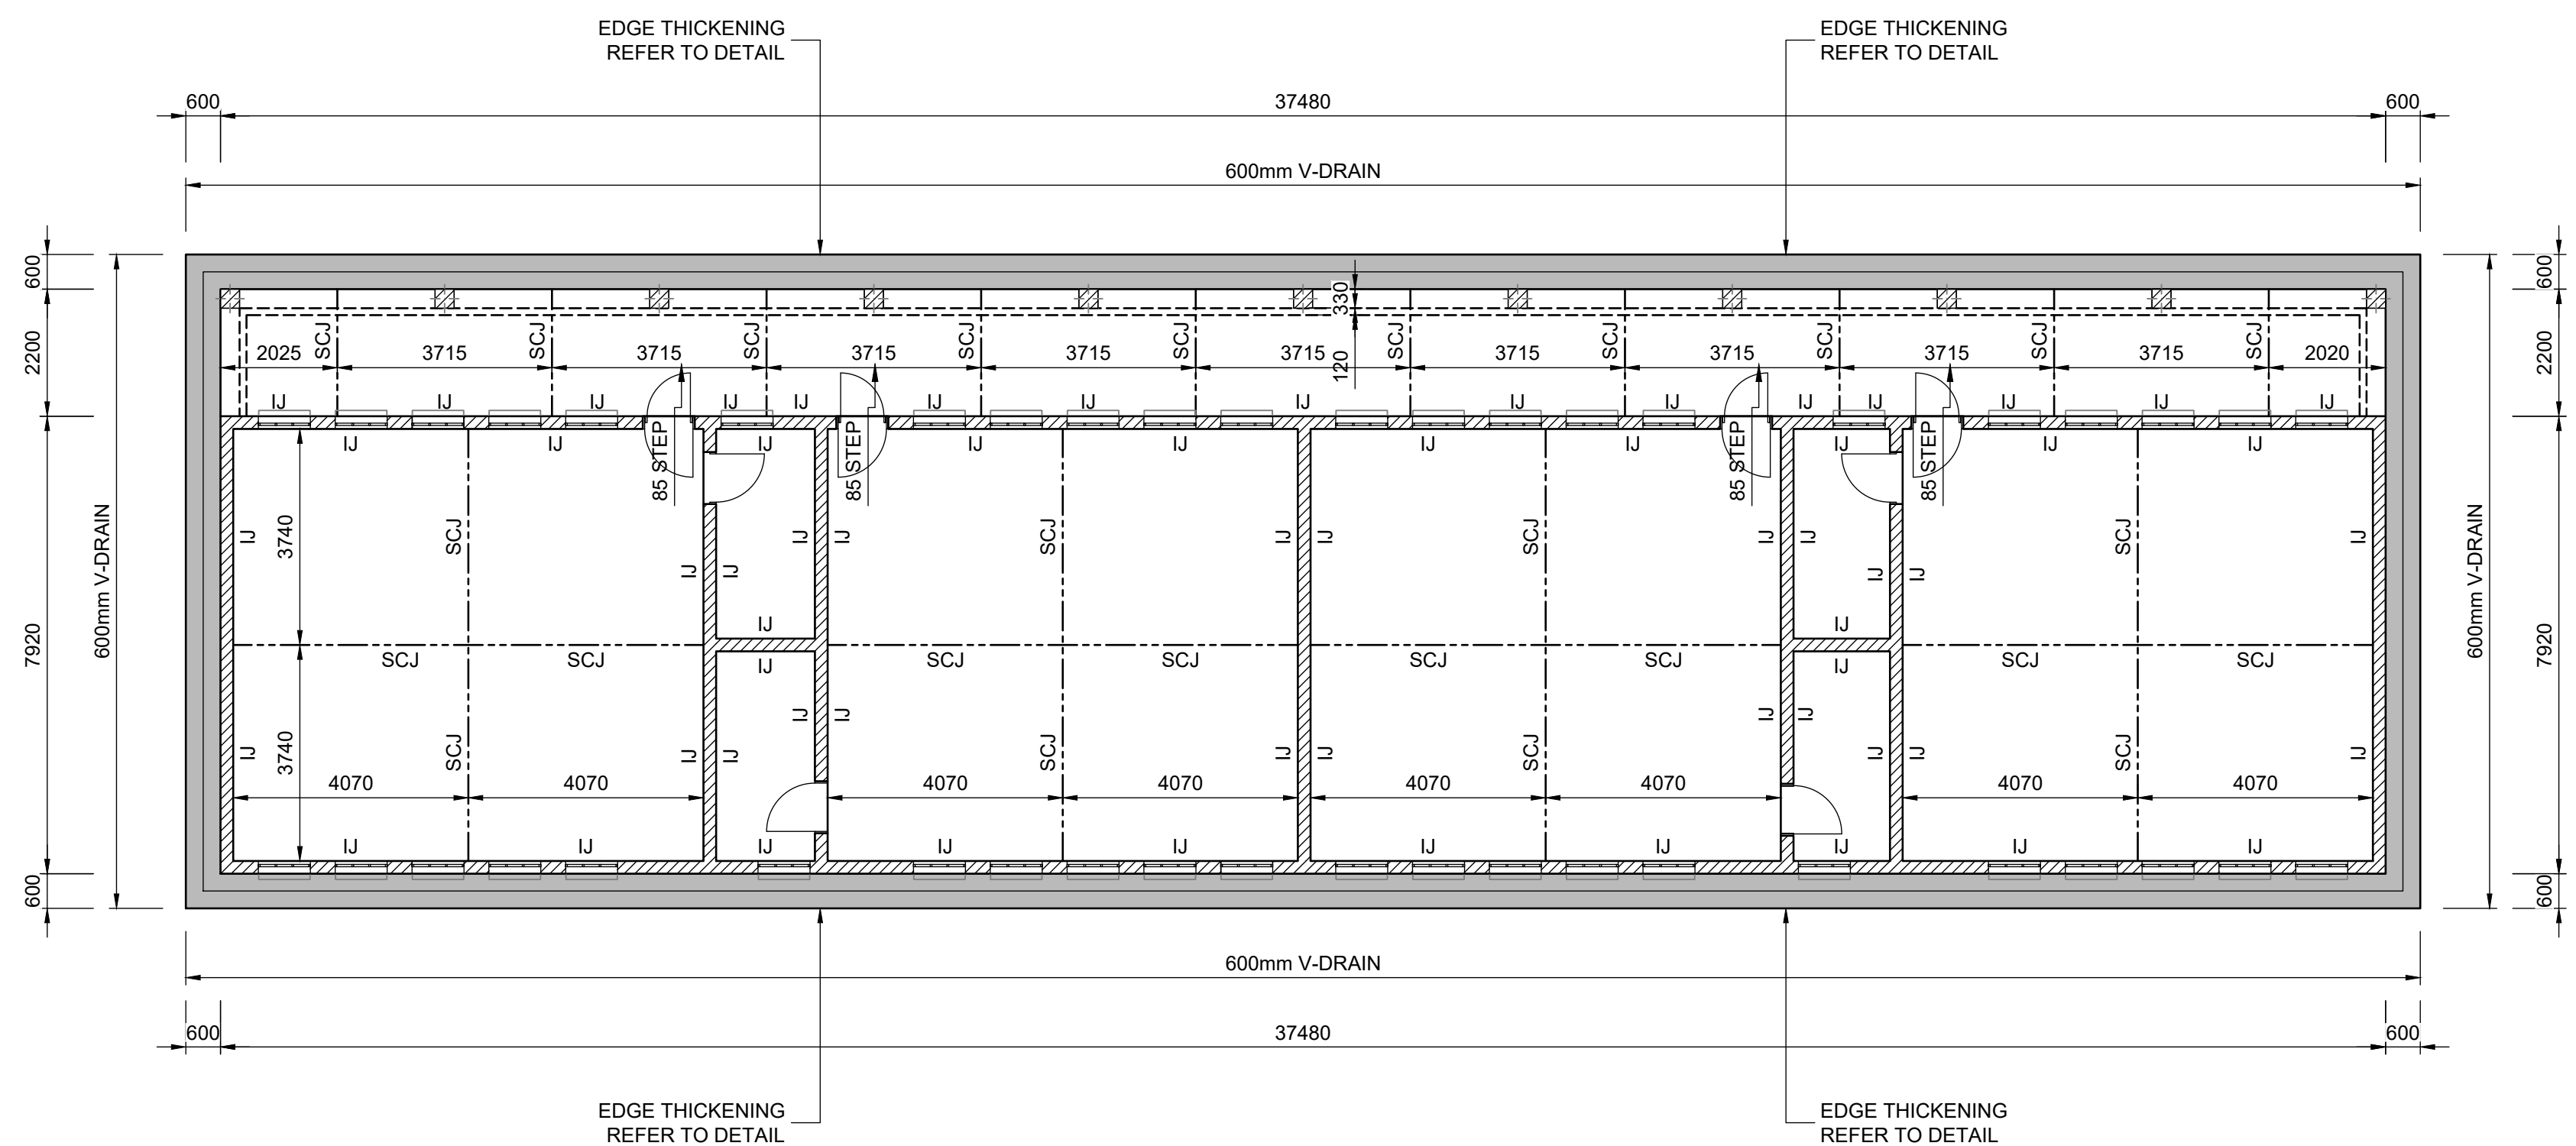

CLASSROOM BLOCK B AND D: SURFACE BED LAYOUT

SCALE 1:100

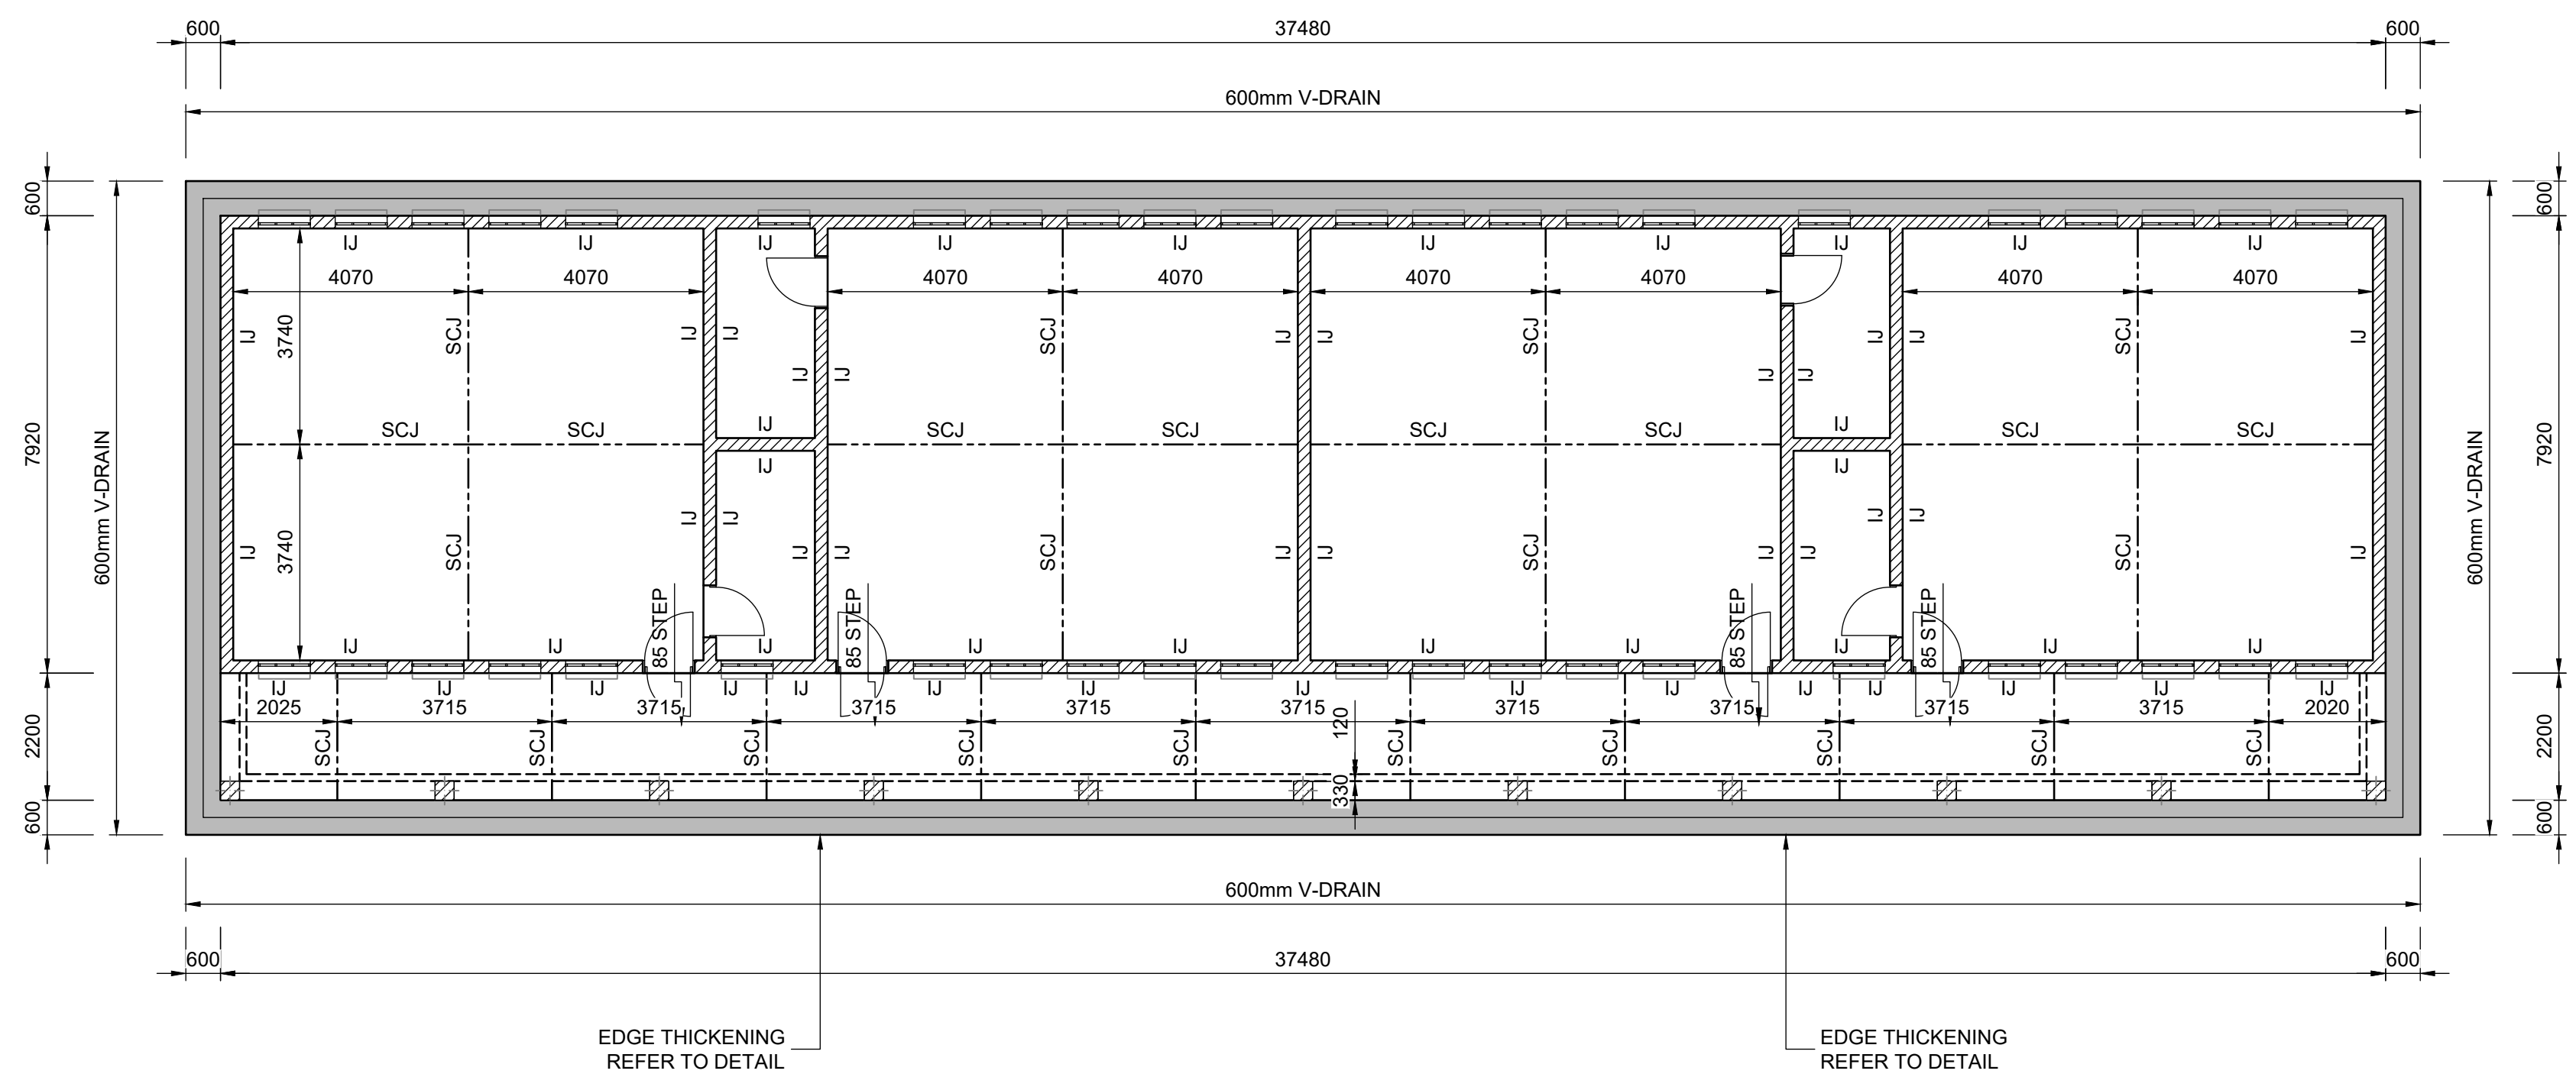

CLASSROOM BLOCK F: SURFACE BED LAYOUT

SCALE 1:100

THIS DRAWING TO BE READ IN CONJUNCTION WITH ARCHITECTS LAYOUTS.
REFER TO DRAWING NUMBER SAB1777-PSS-196 FOR DETAILS.

NOTES:

- ALL WORK IN ACCORDANCE WITH THE RELEVANT SECTIONS OF SANS 1200 AND AS REQUIRED BY THE LOCAL AUTHORITIES OR STATUTORY BODIES.
- WHERE REFERENCE IS MADE TO THE SOUTH AFRICAN STANDARD SPECIFICATIONS, THE CURRENT EDITION SHALL BE USED.
- REFER TO ARCHITECTS LAYOUTS FOR SETTING OUT INFORMATION.
- ALL DIMENSIONS AND LEVELS TO BE CHECKED ON SITE PRIOR TO CONSTRUCTION. ANY DISCREPANCIES TO BE REPORTED TO THE ENGINEER IMMEDIATELY.
- ONLY WRITTEN DIMENSIONS AND LEVELS SHALL BE USED.
- THIS DRAWING TO BE READ IN CONJUNCTION WITH DRAWINGS FROM THE RELEVANT DISCIPLINES, ARCHITECT, CIVIL, ELECTRICAL AND MECHANICAL.
- THE CONTRACTOR SHALL GIVE THE ENGINEER AT LEAST 24 HOURS ADVANCE NOTICE FOR INSPECTIONS.
- THE ENGINEER SHALL BE NOTIFIED WITHOUT DELAY SHOULD THERE BE ANY DISCREPANCIES BETWEEN DRAWINGS, DETAILS AND SPECIFICATIONS.
- FOUNDATION EXCAVATIONS TO BE INSPECTED AND APPROVED BY THE STRUCTURAL / GEOTECHNICAL ENGINEER BEFORE ANY BLINDING IS CAST.
- REINFORCING TO BE CHECKED AND APPROVED BY THE ENGINEER PRIOR TO CASTING CONCRETE.
- ALL DUCTS OR RECESSES TO BE APPROVED BY THE ENGINEER.
- POSITION OF CONSTRUCTION JOINTS TO BE APPROVED BY THE ENGINEER.
- CONCRETE STRENGTHS @ 28 DAYS:
BLINDING : 15 MPa
FOUNDATIONS : 25 MPa
COLUMNS : 30 MPa
SURFACE BEDS : 25 MPa
ROOF SLABS : 30 MPa
BEAMS : 30 MPa
- COVER TO STEEL REINFORCEMENT: U.O.N.
FOUNDATIONS : 50 mm
SLABS : 30 mm
BEAMS : 30 mm
COLUMNS : 30 mm
- ALL SHARP EXPOSED EDGES TO BE CHAMFERED 20 x 20mm.
- ALL WATERPROOFING TO ARCHITECTS DETAIL.
- SAW CUTS ARE TO BE MADE AS SOON AS THE CONCRETE IS FIRM ENOUGH NOT TO BE TORN OR DAMAGED BY THE CUTTING BLADE (USUALLY BETWEEN 24 TO 48 HOURS AFTER CASTING).
- ALL STEELWORK TO BE FABRICATED AND ERECTED IN ACCORDANCE WITH SANS 2001-CS1 & SANS 1921-3.
- ALL STEELWORK TO BE SANS 50025-S355JR UNLESS OTHERWISE NOTED.
- A COMPLETE SET OF SHOP DRAWINGS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL BEFORE FABRICATION COMMENCES.
- ALL WELDS TO BE MINIMUM 6mm CONTINUOUS FILLET WELDS UNLESS OTHERWISE NOTED AND IN STRICT ACCORDANCE WITH SANS AND ANSI/AWS STANDARDS.
- ALL BOLTS SHALL BE GRADE 8.8 UNLESS OTHERWISE NOTED.
- ALL STEELWORK TO BE HOT DIPPED GALVANISED TO SANS 1200-HC AND SANS 121 UNLESS OTHERWISE NOTED.

02	2028-01-27	MG	SS	ISSUED FOR INFORMATION	
01	2023-07-17	MG	KT	ISSUED FOR INFORMATION	
00	2022-11-27	MG	KT	ISSUED FOR INFORMATION	
REV	DATE	DRAWN	CHECKED	DESCRIPTION	
					
PROJECT					
DBSA SCHOOLS FS POPANO SECONDARY SCHOOL FREE STATE					
DRAWING					
SURFACE BED RC LAYOUTS CLASSROOM BLOCKS A,B,C,D,E,F AND G					
	RESPONSIBLE PERSON			DATE	
DESIGNED	MG			2022-11-24	
DRAWN	MG			2022-11-24	
CHECKED	KT			2022-11-27	
APPROVED	MANI GOVENDER [PR ENG - 20080241]			2022-11-27	
SCALE	AS SHOWN			SHEET SIZE	A0
PROJECT NUMBER DRAWING NUMBER STATUS REVISION					
SAB1777-PSS-194-P-02					
DRAWING STATUS CODES:					
R = REPORT		T = TENDER		C = CONSTRUCTION	
D = DRAFT		P = PRELIMINARY		A = AS BUILT	
COPYRIGHT RESERVED					