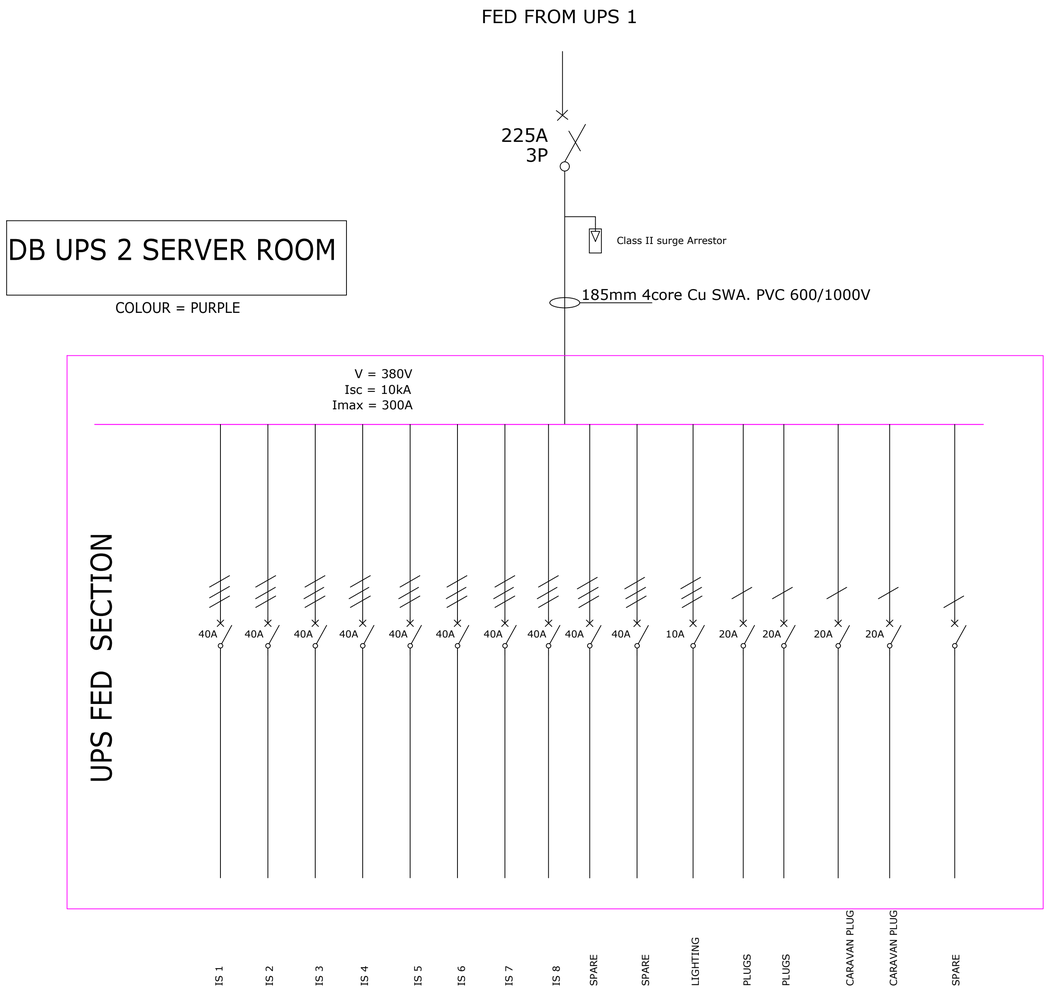


| | IS 1 | IS 2 | IS 3 | IS 4 | IS 5 | IS 6 | IS 7 | IS 8 | SPARE | SPARE | LIGHTING | PLUGS | PLUGS | CARAVAN PLUG | CARAVAN PLUG | SPARE | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| CONDUCTOR (W) CABLE (C) SIZE (mm²) | 4 (W) | 4 (W) | 4 (W) | 4 (W) | 4 (W) | 4 (W) | 4 (W) | 4 (W) | | | 2.5 (W) | 4 (W) | 4 (W) | 4 (W) | 4 (W) | | | | |
| EARTH WIRE SIZE (mm²) | 2.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | | | 1.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | 2.5 (W) | | | | |
| CONDUIT SIZE (Ø mm) | | | | | | | | | | | | | | | | | | | |
| | INDUSTRIAL SOCKET OUTLETS (UPS) | | | | | | | | | | | | | | | | | | |

**GENERAL NOTES:**

A) THIS DRAWING TO BE USED FOR SECURITY, ACCESS CONTROL, FIRE DETECTION, INTERCOM, BGM (P.A.), TELEPHONE AND DATA/ COMMS PURPOSES ONLY.

B) DO NOT SCALE THIS DRAWING.

C) REFER TO ARCHITECTS AND STRUCTURAL ENGINEERS DRAWINGS FOR ALL BUILDING DIMENSIONS, LATEST BUILDING REVISIONS AND SERVICES.

D) THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SECURITY, ACCESS CONTROL, FIRE DETECTION, INTERCOM, BGM (P.A.), TELEPHONE AND DATA/COMMS SPECIFICATION.

E) ALL WORK TO COMPLY WITH RELEVANT STANDARD CODES OF PRACTICE, SPECIFICATIONS AND REGULATIONS.

F) NOT WITHSTANDING ANYTHING TO THE CONTRARY, ALL RIGHTS RESERVED. NO PART OF THIS DRAWING MAY BE REPRODUCED IN ANY MATERIAL FORM (INCLUDING PHOTOCOPYING OR STORING IN ANY MEDIUM OR BY ELECTRONIC MEANS AND WHETHER OR NOT TRANSIENTLY OR INCIDENTALLY TO SOME OTHER USE OF THIS DRAWING) IN WHOLE OR IN PART. THIS DRAWING MAY NOT BE USED FOR ANY PURPOSE OR REASON OTHER THAN THE PURPOSE FOR WHICH IT WAS ORIGINALLY ISSUED, WITHOUT THE WRITTEN PERMISSION OF IBUYA CONSULTING ENGINEERS.

FOR CONSTRUCTION

REVISIONS

| NO. | DATE | DESCRIPTION | REV BY: |
|---|---|---|---|
| | | | |

© COPYRIGHT: THIS DRAWING MAY NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS IN PART OR IN WHOLE WITHOUT THE PERMISSION OF THE DESIGNER.

ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH SANS CODE 10400, N.B.R & LOCAL AUTHORITY BYLAWS.

USE FIGURED DIMENSIONS ONLY - DO NOT SCALE. ANY CONSTRUCTION FROM THESE DRAWINGS IS AT OWNER'S RISK.

ALL BOUNDARIES, DIMENSIONS AND LEVELS ARE TO BE CHECKED ON SITE BEFORE CONSTRUCTION AND ANY DISCREPANCIES ARE TO BE REPORTED TO THE ARCHITECT.

PARTIAL SERVICE: ANY DISCREPANCIES WITH SITE OR OTHER INFORMATION IS TO BE ADVISED TO THE ARCHITECT AND DIRECTION OR APPROVAL IS TO BE SOUGHT BEFORE IMPLEMENTATION OF THE DRAWING.

FOR THE PURPOSE OF COORDINATION: ALL RELEVANT PARTIES MUST CHECK THIS INFORMATION PRIOR TO IMPLEMENTATION AND REPORT ANY DISCREPANCIES TO THE ARCHITECT.

Engineer: M. Kola

Pr Eng: 20110196 Date: 26.01.2025

DBSA

Client: Government Printing Works

Signature: Date:

government printing
Department:
Government Printing Works
REPUBLIC OF SOUTH AFRICA

PROJECT:
THE UPGRADE AND REPAIR AT THE GOVERNMENT PRINTING WORKS ADMINISTRATIVE HEADQUARTERS
ADDRESS:
ERF 3265, 379 Sophie de Bruyn St
Pretoria Central, 0002, RSA.

DRAWING TITLE:
DB - UPS S1, SINGLE-LINE SCHEMATIC LAYOUT

| Building Classification: | | Climatic Zone: |
|---|---|---|
| G1_Offices | | Zone 2: |
| Paper Size: A0 | | Scale: AS SHOWN |
| Drawn: B.M | Checked: M.K | Date: 24/10/2025 |

ISSUED FOR CONSTRUCTION

PROJECT No. GPW/HQ/2017/02
DRAWING No.: EE -3002 -C
REVISION: 0